



UNIVERSITY OF LEEDS

This is a repository copy of *Cost and performance of some carbon capture technology options for producing different quality CO₂ product streams*.

White Rose Research Online URL for this paper:
<http://eprints.whiterose.ac.uk/109460/>

Version: Accepted Version

Article:

Porter, RTJ, Fairweather, M, Kolster, C et al. (3 more authors) (2017) Cost and performance of some carbon capture technology options for producing different quality CO₂ product streams. *International Journal of Greenhouse Gas Control*, 57. pp. 185-195. ISSN 1750-5836

<https://doi.org/10.1016/j.ijggc.2016.11.020>

© 2016 Elsevier Ltd. Licensed under the Creative Commons Attribution-NonCommercial-NoDerivatives 4.0 International
<http://creativecommons.org/licenses/by-nc-nd/4.0/>

Reuse

Unless indicated otherwise, fulltext items are protected by copyright with all rights reserved. The copyright exception in section 29 of the Copyright, Designs and Patents Act 1988 allows the making of a single copy solely for the purpose of non-commercial research or private study within the limits of fair dealing. The publisher or other rights-holder may allow further reproduction and re-use of this version - refer to the White Rose Research Online record for this item. Where records identify the publisher as the copyright holder, users can verify any specific terms of use on the publisher's website.

Takedown

If you consider content in White Rose Research Online to be in breach of UK law, please notify us by emailing eprints@whiterose.ac.uk including the URL of the record and the reason for the withdrawal request.



eprints@whiterose.ac.uk
<https://eprints.whiterose.ac.uk/>

Cost and performance of some carbon capture technology options for producing different quality CO₂ product streams

Richard T.J. Porter^{a,†,*}, Michael Fairweather^b, Clea Kolster^{c,d}, Niall Mac Dowell^{c,d}, Nilay Shah^d and Robert M. Woolley^b

^aEnergy Research Institute, School of Chemical and Process Engineering, University of Leeds, Leeds LS2 9JT, UK.

^bInstitute of Particle Science and Engineering, School of Chemical and Process Engineering, University of Leeds, Leeds LS2 9JT, UK.

^cCentre for Environmental Policy, Imperial College London, London SW7 1NA, UK.

^dCentre for Process Systems Engineering, Department of Chemical Engineering, Imperial College London, London SW7 2AZ, UK.

[†]Current address: Department of Chemical Engineering, University College London, Torrington Place, London WC1E 7JE, UK.

* Corresponding author: Tel: +44(0)207 679 3809

Email address: R.T.J.Porter@ucl.ac.uk (Richard T.J. Porter).

Submission of a full-length article to the International Journal of Greenhouse Gas Control, of unpublished material not submitted for publication elsewhere

ABSTRACT

A techno-economic assessment of power plants with CO₂ capture technologies with a focus on process scenarios that deliver different grades of CO₂ product purity is presented. The three leading CO₂ capture technologies are considered, namely; oxyfuel combustion, pre-combustion and post-combustion capture. The study uses a combination of process simulation of flue gas cleaning processes, modelling with a power plant cost and performance calculator and literature values of key performance criteria in order to evaluate the performance, cost and CO₂ product purity of the considered CO₂ capture options. For oxyfuel combustion capture plants, three raw CO₂ flue gas processing strategies of compression and dehydration only, double flash system purification and distillation purification are considered. Analysis of pre-combustion capture options is based on integrated gasification combined cycle plants using physical solvent systems for capturing CO₂ and sulfur species via three routes; co-capture of sulfur impurities with the CO₂ stream using Selexol™ solvent, separate capture of CO₂ and sulfur impurities using Selexol™, and Rectisol® solvent systems for separate capture of sulfur impurities and CO₂. Analysis of post-combustion capture plants was made with and without some conventional pollution control devices. The results highlight the wide variation in CO₂ product purity for different oxyfuel combustion capture scenarios and the wide cost variation for the pre-combustion capture scenarios. The post-combustion capture plant with conventional pollution control devices offers high CO₂ purity (99.99 mol%) for average cost of considered technologies. The calculations performed will be of use in further analyses of whole chain CCS for the safe and economic capture, transport and storage of CO₂.

Dedication: This paper is dedicated to the memory of our friend and colleague, Dr. Robert M. Woolley, who made a significant input to the CO₂QUEST project and whose expertise, commitment and great humour will never be forgotten.

KEYWORDS

Carbon Capture and Storage, CCS, Cost Estimates, CO₂ Impurities, CO₂ Quality

1. INTRODUCTION

CO₂ Capture and Storage (CCS) technologies will produce CO₂ product streams that are expected to contain a range of impurities at certain levels depending on the technology type and several other factors. The impact of these impurities on the safe and economic transportation and storage of CO₂ is a fundamentally important issue that must be addressed prior to wide scale deployment of CCS (CO₂QUEST, 2015). The ultimate composition of the CO₂ streams captured from fossil fuel power plants or other CO₂ intensive industries and transported to storage sites using high pressure pipelines will be governed by safety, environmental and economic considerations. Even though from a technological perspective, very high purity CO₂ from fossil fuel-fired power plant flue gas is achievable, it may not be required for some transport and storage applications, and so the associated increase in cost in achieving high purity levels may be avoided. Conversely, the extent to which impurities can be co-disposed along with CO₂ in capture streams is currently uncertain in terms of its technical feasibility and acceptability. Impurities in CO₂ mixtures can potentially cause problems with compression, as well as corrosion issues for pipeline transport. Economic viability and acceptability in terms of the risks to health and the environment are also crucial factors. Pipeline operators and CO₂ end users may impose regulations that limit impurities concentrations that are accepted, therefore further purification will become necessary. Some previous studies have assumed that impurities can be co-captured for co-disposal while others assume flue gas purification is necessary. Therefore, it is important to determine the optimal balance between purification costs and the transport and storage requirements. This study presents a cost benefit analysis in relation to product purity in CO₂ capture systems to enable the evaluation of the economic viability of co-capture scenarios in full chain CCS systems.

Impurities in CO₂ captured from combustion-based power generation with CCS can arise in a number of ways and include major and minor fuel oxidation products (e.g., H₂O, SO_x, NO_x, Hg), air related impurities (N₂, O₂ and Ar) and process fluids, such as solvents (e.g. monoethanolamine (MEA) and SelexolTM) used for capture (Porter et al., 2015). CO₂ impurities are known to have a number of mainly detrimental impacts on the downstream transport and storage CCS chain elements. CO₂ impurity impacts can be classified into chemical (e.g. those caused by SO₂), physical impacts (e.g. those caused by N₂) and toxic/ecotoxic effects (e.g. those caused by mercury) (Farret, 2015). The numerous types of impacts of impurities on transport and storage in CCS have been outlined in two reports by

the IEAGHG (2004; 2011) and further studies by the National Energy Technology Laboratory (NETL) (Matuszewski and Woods, 2012) and the Dynamis project (de Visser et al., 2008) which have provided recommended impurity limits for CO₂ stream components in studies of CO₂ capture utilisation and storage systems. Limits are suggested based upon a number of different factors and these quality guidelines may serve as a basis for conceptual studies.

Of the different capture technologies, oxyfuel combustion is known to have the widest possible range of CO₂ purity, being dependent mostly on the selection of the CO₂ purification strategy (e.g. compression and dehydration only, “double flash” phase separation, or cryogenic distillation). Detailed modelling of these processes has been reported in work performed by Mitsui Babcock, Alstom and Air Products for the IEAGHG (Dillon et al., 2005) with costs and CO₂ product quality reported. Further process simulation studies have aimed to optimise these processes (Posch and Haider, 2012) and have analysed the impact of impurities on the purification requirements (Li et al., 2009). The highest concentration impurities from oxyfuel combustion capture are O₂, N₂ and Ar, but SO_x and Hg may also be present at certain levels posing corrosion concerns.

The level of CO₂ purity derived from pre-combustion capture in Integrated Gasification Combined Cycle (IGCC) plants has a narrower range as compared to oxyfuel combustion capture. Potentially problematic impurities from pre-combustion capture are H₂S, due to corrosion issues when mixed with water, and H₂ which can lead to increased pumping costs and reduced storage capacity. Process factors that have a large influence on the CO₂ purity in pre-combustion capture include the choice of solvent and the CO₂ capture process configuration and, in particular, the decision whether to remove sulfur species simultaneously with CO₂ (co-capture scenario) or to remove them in a separate stream for possible further processing (separate capture scenario). The potential benefits of co-capturing impurities in pre-combustion gasification systems have been investigated in a report published by the IEAGHG (2004), resulting in cost savings relative to CO₂-only capture for SelexolTM solvent systems. Ordorica-Garcia et al. (2006) have performed detailed process system simulation studies of IGCC systems with glycol solvents with plants that co-capture impurities showing substantial techno-economic advantages over separate capture plants due to their decreased energy penalty and lower capital costs. Further work by Padurean et al. (2012) has compared the techno-economics of the use of different solvents in IGCC at different levels of CO₂

capture, concluding that SelexolTM is the more energy efficient solvent when compared to the others investigated such as Rectisol[®].

Post-combustion capture generally has low levels of impurities, with dried CO₂ purity usually reported in excess of 99% (E.C., 2011; CO₂PIPETRANS, 2008) and impurities are less of an issue, N₂, water and O₂ are the main impurities of highest concentration. Estimates for the efficiency penalty typically range between 8-16 percentage points for pulverised coal plants with post-combustion capture units (Goto et al., 2013). Techno-economic studies often aim to find the optimal configuration for the process (Rao and Rubin, 2006; Schach et al., 2011;). Lee et al. (2009) estimated the impurities included in the CO₂ stream from a post-combustion capture control unit with different combinations of air pollution control devices and different flue gas compositions, concluding that plants employing Flue Gas Desulfurisation (FGD) systems followed by absorption using monoethanolamine are the most favourable in terms of minimising the impacts from CO₂ impurities in geological storage.

Comparative techno-economic assessments of CO₂ capture technologies as applied to fossil fuel power plants have been performed by a number of authors (Rubin et al., 2005, 2007; Ekström et al., 2009; Parsons Brinckerhoff, 2012), including those that incorporate a significant portion of biomass in the fuel input (Al-Qayim et al., 2015; Catalanotti et al., 2014). However, to our knowledge, there has been no published study of a cross-comparative cost-benefit analysis for producing CO₂ product streams of different quality from the three leading capture technologies of oxyfuel combustion capture, pre-combustion capture and post-combustion.

The purpose of this paper is to develop an understanding of the dependence of capture cost on the required purity level. A scenario-based cost analysis is presented for the three capture technologies of oxyfuel combustion capture, pre-combustion capture and post-combustion capture with respect to impurities removal and variation. The scenarios include different power plant configurations and options for CO₂ purification. The performance of the different scenarios with respect to mass and energy balances, energy production and CO₂ purity is assessed. To account for the many factors that affect the power output, cost of electricity, emissions and cost of CCS at combustion based power plants, we have used the Integrated Environmental Control Model (IECM) to perform techno-economic calculations. The IECM was selected because it provides ready built in process performance models for a range of

combustion based power generation and CO₂ capture technologies and therefore extends the scope of this study to a large range of scenarios. The IECM model cases have been supplemented in some areas where necessary using calculations performed using a process systems simulator and with information gathered from a detailed literature survey. The engineering cost models are applied to calculate capital costs in addition to operational and maintenance costs; these costs are then used to calculate the cost of electricity and other techno-economic indicators for each of the technologies and scenarios considered. Finally, the costs of each scenario and different CO₂ purity levels are compared and discussed.

2. ANALYSIS OF OXYFUEL COMBUSTION CARBON CAPTURE WITH RESPECT TO COST AND CO₂ IMPURITIES

2.1 Modelling methods and assumptions

Currently, one of the leading technologies for CO₂ capture from coal fired power plants is oxy-combustion capture. This capture method comprises of an ASU to produce a high purity oxygen stream which is mixed with recycled flue gas, providing an oxidation environment in which to burn the fuel that is low in nitrogen but has similar characteristics to those encountered in air combustion. The flue gas produced by oxyfuel combustion will vary in purity, and still requires dehydration, further purification and compression in order to be suitable for transport and storage. The latter is performed by means of a CO₂ compression and purification unit (CO₂CPU). A great deal of work to date has focused on optimising the combustion process (Edge et al., 2011; Seepana and Jayanti, 2012; Tan et al., 2006) and minimising the energy penalty caused by the ASU which is usually around 5 percentage points (Boot-Handford et al., 2014). In contrast, little work has been undertaken on reducing the energy penalty caused by the CO₂CPU which, through this study, is also found to fluctuate by around 5 percentage points.

Highlighting the importance of the CO₂CPU within the oxyfuel combustion capture process, three variations of the unit were modelled in Aspen HYSYS V8.4 with the objective of using the results to supplement whole plant techno-economic calculations that will be presented in section 2.4. The first CO₂CPU model is the most simplistic, consisting of a six-stage compression and dehydration system. The two remaining models are more complex systems,

built on the compression and dehydration model, with different product stream purities. One consists of a double flash system with heat integration and the other of a six-stage distillation column also with heat integration. As these models increase in complexity, they also increase product purity with, as will be discussed later, variations in capture efficiency, energy penalty, and capital and operational costs.

These models were based on similar approaches to those presented by Posch and Haider (2012) using a Peng-Robinson property method with mixing parameters taken from Eggers and Köpke (2008). These were found to be most suitable for the components considered in the flue gas (CO₂, H₂O, N₂, Ar, O₂, SO₂) and the range of temperatures (-60°C to 250°C) and pressures (1 bar to 120 bar) considered. Each plant was assumed to have 8460 working hours per year and a plant lifetime of 35 years. The flue gas inlet composition and flow rate considered were taken from a pulverised coal firing power plant at nominal load (~350 MWe) retrofitted from an existing plant (Posch and Haider, 2012). These values are summarised in Table 1.

Table 1. Example of raw flue gas produced from an oxy-combustion pulverised fuel power plant (taken from Posch and Haider (2012)).

Flue Gas Properties (CPU inlet)	Value
Temperature	13.2 °C
Pressure	1 bar
Flow Rate	342.7 tonne/hr
Composition (mole %):	
CO ₂	76.38
O ₂	7.83
N ₂	11.34
Ar	3.11
H ₂ O	1.34
SO ₂	(100 ppm)

2.2 CO₂ compression and purification system process scenarios

In this section, three CO₂ compression and purification unit models developed in Aspen HYSYS V8.4 are briefly described. More detailed descriptions can be found elsewhere

(Kolster et al., In prep.) and for similar processes in (Posch and Haider, 2012). Detailed simulations of the CO₂ Compression and Purification Unit (CPU) section of the plant which can deal with the removal of non-condensable components of N₂, O₂ and Ar, and compression of the product stream to high pressures (> 100 bar) were carried out. Based on the same composition and flow rate of raw oxyfuel CO₂ flue gas shown in table 1, three different compression and purification process strategies were considered:

- 1) CO₂ compression and dehydration only
- 2) ‘Double flash’ purification system
- 3) Distillation purification system

In all cases, the CO₂ product pressure is 120 bar. The first case of CO₂ compression and dehydration only, consists of a 3-stage compression train with interstage cooling and flash separation, followed by a dehydration step and a final 3-stage compression train with interstage cooling to the final delivery pressure. In the second double flash case, a 3-stage compression train with interstage cooling and flash separation followed by a dehydration step is again used. Following this, the flue gas is cooled to low temperatures in 2 multi-stream heat exchangers which are each followed by flash separation vessels. A CO₂ rich liquid stream exits the bottom of the flash separation vessels and stream rich in non-condensable gases exits the top. Cooling for the multi-stream heat exchangers is provided by auto-refrigeration expansion of the CO₂ product stream. The product stream is compressed further in a 3-stage compression train with interstage cooling. The third distillation case is similar to the double flash case but with phase separation handled by a 6-stage distillation column instead of the double flash vessel system.

2.3 CO₂ compression and purification system performance and cost

CO₂CPU performance and costs were evaluated using AspenTech Activated Economics Analysis (Hegy et al., 2013) using a UK metric based cost system. Costs were then converted to euros. The internal cost of electricity (defined as the price the base plant sells electricity to other plant areas and used to calculate their O&M costs) was equal to 0.0733 €/kWh.

The capture efficiency of each system was calculated using:

$$\eta_{cap} = \frac{\dot{m}_{CO_2 \text{ product}}}{\dot{m}_{CO_2 \text{ inlet}}} \quad (1)$$

where η_{cap} is the capture efficiency of CO₂ from the initial flue gas into the system, $\dot{m}_{CO_2 \text{ product}}$ is the mass flow rate of CO₂ out of the system (after product compression for storage), and $\dot{m}_{CO_2 \text{ inlet}}$ is the mass flow rate of CO₂ into the system (before the pre-compression stage).

As shown in Table 2, as the models increase in complexity (Distillation > Double Flash > Compression and Dehydration) and in product purity, the capital and operational costs incurred increase as well. This implies an increase in energy requirement per tonne of CO₂ captured as well as an increase in the power plant net efficiency loss with complexity and product purity. In addition, while the systems decrease in product purity and complexity, they increase in capture efficiency (see Equation (1)). The compression and dehydration system captures 100% of the CO₂ in the system, whereas the double flash and distillation plants capture 92% and 90%, respectively, of the CO₂ entering the system as a raw flue gas. The latter indicates that, with decreased system complexity, less CO₂ would be vented to the atmosphere and indeed more of the CO₂ coming into the system would be captured.

Table 2. System performance and economic evaluation of the three CO₂CPUs modelled.

Property of CPU	Compression and dehydration only	Double flash	Distillation
CO ₂ Product Stream Mt/year	2.88	2.25	2.16
Capital Cost	€42 M	€43 M	€65 M
Operating Cost per Annum	€35 M	€41 M	€43 M
Product CO ₂ Purity (mole %):	77.40	96.61	99.99
CO ₂ Capture Efficiency η_{cap}	100%	92%	90%
Unit Energy (kWh/tonne of CO ₂ captured)	103	150	172

2.4 Impact of CO₂ compression and purification system selection on overall plant costs and CO₂ purity

In this section, the modelling input parameters and results from the oxyfuel compression and purification systems considered in Sections 2.1 to 2.3 are used to develop an understanding of the overall oxyfuel combustion plant capital costs, operating and maintenance (O&M) costs and Levelised Cost of Electricity (LCOE). To account for the many factors that affect the

power output and the cost of CCS in oxyfuel combustion power plants, we have used the Integrated Environmental Control Model (IECM) to perform whole plant techno-economic calculations. In this study, version 9.0.1 Beta of IECM was employed which allows for the techno-economic modelling of oxyfuel combustion capture with an integrated ASU. Environmental control techniques were also considered in the modelling, and these include in-furnace NO_x control, and the use of an electrostatic precipitator (ESP) and wet flue gas desulfurisation (FGD). Prior to entry of the CO₂ CPU unit the raw CO₂ flue gas is also considered to be cooled and dehumidified in a direct contact cooler (DCC). The process performance model calculations are based on fundamental mass and energy balances, which together with user-specified plant size, empirical relationships and sub-models are used to define component and system mass flows, energy flows and the efficiencies of unit operations. The final CO₂ product purity may be specified by the user along with the CPU unit energy requirement and other performance parameters for this unit. The process performance calculations are linked to engineering economic and financial models for each major process area in order to calculate the capital costs and O&M costs (consisting of fixed and variable costs) of various plant components. The cost models for each of the many process areas come from a variety of sources and therefore have a variety of origin dates. Costs are reported for years ranging from three decades ago, but are scaled to other years using the chemical engineering plant cost index. Cost data are used to form scaling relationships based on material flows through each unit operation. The data and scaling relationships for the process cost models form part of the IECM and further details of these can be found in the technical documentation of the software (IECM, 2015). The capital and O&M costs are used to calculate the LCOE for the overall plants. The LCOE represents the per-kilowatt hour cost of building and operating a generating plant over its lifetime. The LCOE is implemented in IECM as:

$$\text{LCOE } (\$/MWh) = \frac{(\text{TCC})(\text{FCF}) + \text{FOM}}{(\text{CF})(8760)(\text{MW})} + \text{VOM} + (\text{HR})(\text{FC}) \quad (2),$$

where TCC is the Total Capital Cost (\$), FCF is the Fixed Charge Factor (fraction), FOM is the Fixed Operating & Maintenance costs (\$/yr), VOM is the Variable Operating & Maintenance Costs, excluding fuel costs (\$/MWh), HR is the power plant Heat Rate (MJ/MWh), FC is the unit Fuel Cost (\$/MJ), CF is the annual average Capacity Factor (Fraction) and MW is the net power plant capacity.

Comparison of plants with the three CPU technologies described in Sections 2.1 to 2.3 is made based on a set of technical and financial assumptions. In each case, the reference plant is a 400 MW gross power output facility with oxyfuel carbon capture. The plants use a low sulfur bituminous coal and are supercritical units. Financial data used in all cases are the same. Costs generated in the IECM were based on 2012 USD; a conversion factor of 0.96 was applied in the conversion from 2012 USD into 2014 €. Costs are expressed in the constant form. The costs and financial assumptions were partially based on those suggested by the NETL in previously published DOE reports (Grol et al., 2011; Rubin et al., 2007) relating to US plants, and those provided in Sections 2.1 to 2.3. A review of CCS techno-economic evaluations from numerous studies by Rubin et al. (2015) that are based on either European or US assumptions show considerable overlap for plant performance and costs; however, fuel prices and price trends between US and European studies are very different. Further details of the technical and financial assumptions for the cases of the present study are summarised in Table 3. The costs given refer to retrofitted plants in order to maintain compatibility to the calculations presented in Sections 2.1 to 2.3 that are based on the detailed retro-fit study for an existing coal power plant by Posch and Haider (2012). Older coal fired plants operate at higher excess oxygen than modern state of the art technology. In addition, air ingress in retrofit situations will be higher than in new build oxyfuel systems. As a consequence, the oxygen concentration in the raw CO₂ flue gas is higher and the requirements for the CO₂CPU are similarly higher in retrofit as compared to new build oxyfuel CCS. The total capital required for non-CCS plant components was amortised by 25% to account for the financial implications of retrofit.

Table 3. Key assumptions for the oxyfuel combustion plants.

Parameter	Compression and dehydration only*	Double flash*	Distillation*
Fuel	Low sulfur bituminous coal [†]	Low sulfur bituminous coal [†]	Low sulfur bituminous coal [†]
Gross Power Output (MW)	400	400	400
Net Power Output (MW)	310	270.6	265.8
Net Plant Efficiency, HHV (%)	33.81	29.51	28.99
Capacity Factor (%)	96.5	96.5	96.5
Fixed Charge Factor (%)	17.21	17.21	17.21
Fuel Price (€/GJ, HHV)	1.75	1.75	1.75
CO ₂ Capture Efficiency (%)	100	92	90

* Supercritical boiler; electrostatic precipitator particulate control system and wet FGD system SO_x removal units (85% removal efficiency) are included.

[†] As-fired properties are: 71.74 wt% C, 4.62 wt% H, 6.09 wt% O, 0.07 wt% Cl, 0.64 wt% S, 9.79 wt% ash, 5.63 and 30.42 MJ kg⁻¹ HHV.

Table 4 summarises the major results of the oxyfuel combustion plant analysis. The oxyfuel plant with distillation type CO₂ purification has the highest CO₂ emission rate, followed by the double flash case. The plant with compression and dehydration only has zero CO₂ emissions due to its 100% capture efficiency. The compression and dehydration only plant also has the lowest LCOE due in large part to it having the lowest energy penalty for final CO₂ processing. Table 4 also shows that the cost of CO₂ avoided (€/tonne CO₂), defined as the difference in LCOE compared to an unabated reference plant without equipment for CO₂ capture but with all other equipment and assumptions remaining the same, divided by the difference in CO₂ emission rate per MWh of the capture and reference plant, is highest for the distillation system and lowest for the compression and dehydration system. The capital cost of a 400 MW_g plant with a double flash CO₂ purification in M€ is roughly the same as the plant with compression and dehydration, at 1183 and 1180 M€, respectively. However, the compression and dehydration only case has the lowest capital cost expressed in €/kW-net due to its lower CO₂ capture energy penalty. As one might expect, the cost of electricity increases with increasing CO₂ purity, due largely to the increasing energy penalty for CO₂ purification and the increasing capital cost for the distillation case. As the value of 8460 plant working hours per year may represent an upper limit for most operations, figure 1, shows the variation of LCOE with plant working hours (using equation 2) to increased values of 174.2, 200.0 and 210.0 €/MWh for dehydration only, double-flash and distillation only oxyfuel combustion capture scenarios, respectively when the plant annual working hours are decreased to 5256 hrs (60 % capacity).

Table 4. Results of techno-economic calculation for the oxyfuel combustion plant cases.

Parameter	Compression and dehydration only	Double flash	Distillation
CO ₂ Emission Rate (kg/MWh)	0	84.5	107.5
CO ₂ Captured (kg/MWh)	1108	997.4	974.8
Total Capital Required (€/kW-net)	3806	4371	4608
Total O&M Costs (M €/yr)	101.9	102.0	103.6
Cost of Electricity* (€/MWh)	116.3	133.5	139.8
Cost of CO ₂ Avoided*** (€/tonne CO ₂)	70.97	103.52	116.1
Product Stream Composition:			
CO ₂	77.69 mol% [†]	96.61 mol% ^{††}	99.99 mol% ^{††}
O ₂	7.61 mol% [†]	1.40 mol% ^{††}	0.55 ppmv ^{††}
N ₂	11.63 mol% [†]	1.46 mol% ^{††}	0.34 ppmv ^{††}
Ar	2.98 mol% [†]	0.51 mol% ^{††}	0.22 ppmv ^{††}
H ₂ O	126 ppmv [†]	0 ^{††}	0 ^{††}
SO ₂	126 ppmv [†]	136 ppmv ^{††}	137 ppmv ^{††}
SO ₃	1.31 ppmv [†]	1.63 ppmv [†]	1.69 ppmv [†]
HCl	8.27 ppmv [†]	-	-
NO _x (NO / NO ₂)	424 / 22.3 ppmv [†]	81 ppmv [†]	20 ppmv [†]
NH ₃	5.2 ppmv [†]	-	-

All costs in constant 2014 Euros.

* Levelised cost excluding tax on emissions and cost of CO₂ transport and storage.

** All avoided cost values are relative to a reference plant without CO₂ capture for the same system.

[†] Calculated by IECM.

^{††} Calculated by Aspen HYSYS.

[‡] Assumed on the basis of literature studies (Kather and Kownatzki, 2011; Pipitone and Bolland, 2009; Porter et al., 2015)

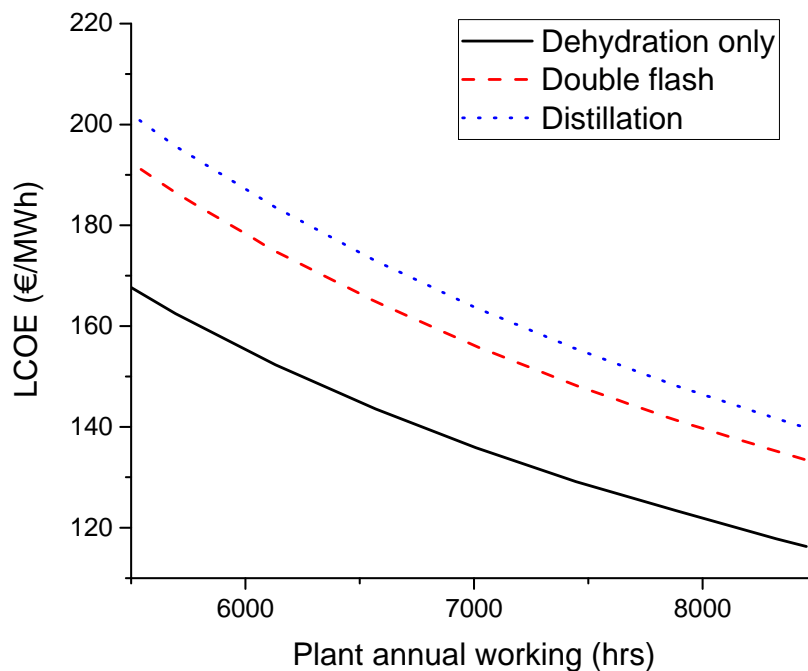


Figure 1. Variation of LCOE (€/MWh) with annual plant working hours for the different oxyfuel combustion capture technologies.

3. ANALYSIS OF PRE-COMBUSTION CARBON CAPTURE WITH RESPECT TO COST AND CO₂ IMPURITIES

In this section an understanding is developed of the influence of process configuration, fuel characteristics and CO₂ capture technology on the purity of CO₂ product deriving from pre-combustion carbon capture in an integrated gasification combined cycle (IGCC) power plant. Impurities in the product CO₂ stream from IGCC-CCS applications arise mainly from components contained in the syngas produced from the gasification of coal or other fuels (e.g. biomass). Other sources of impurities in IGCC-CCS include the physical solvents such as those based on methanol (e.g. Rectisol[®]). Syngas sulfur species predominantly consist of hydrogen sulphide (H₂S) with roughly 5% of the sulfur species being carbonyl sulfide (COS). COS can be converted to H₂S in a water gas shift reactor and the same physical solvents used for CO₂ capture in IGCC are also used to capture H₂S. There are two possible separation processes for dealing with the captured H₂S; namely, separate capture and co-capture. In the separate capture configuration, H₂S is isolated in a separate stream and further processed to elemental sulfur in a Claus process. In the co-capture configuration, H₂S is separated into the CO₂ product stream and the requirement for the H₂S processing plant is eliminated. The co-capture configuration offers significant capital and O&M cost savings over the separate capture approach as a smaller capture plant with a lower energy requirement can be used. A cost disadvantage of the co-capture configuration is the loss of revenue from the sale of elemental sulfur. Despite the economic advantages of co-capture IGCC, there are concerns surrounding the impact of H₂S on downstream capture and storage. In enhanced oil recovery (EOR) applications, however, H₂S is known to reduce the minimum miscibility pressure of oil and CO₂ mixtures and can therefore have a beneficial effect by reducing EOR energy requirements. Co-injection of H₂S for EOR has been employed extensively in Canada, such as in the Weyburn CO₂ injection project.

A physical solvent favoured for pre-combustion capture, Selexol[™], consists of dimethyl ethers of polythene glycol. Selexol[™] has the advantages of high solvent stability, low volatility and low vapour pressure, so that losses during regeneration are minimised (Mohammed et al.; 2014). The Selexol[™] process is also relatively less complex than the process needed for another methanol based solvent considered for IGCC-CCS, i.e. Rectisol[®]. Operating costs for Rectisol[®] can also be higher due to the refrigeration requirement for low operating temperatures. However, Rectisol[®] can be used in a flexible process that can lead to

higher purity syngas and CO₂ product streams. The different process options for pre-combustion CO₂ capture are further discussed in Section 3.2.

3.1 Modelling methods and assumptions

The IECM model described in Section 2.4 is again used to calculate the cost of pre-combustion carbon capture technologies using the same financial assumptions. Three main scenarios are explored; SelexolTM with separate capture of impurities, Rectisol[®] with separate capture of impurities, and SelexolTM with co-capture of impurities. The potential for analysing the use of Rectisol[®] with co-capture of impurities was reviewed; however, due to the lack of available data on capital and operating costs of this process it was not possible to calculate its overall costs. As the IECM model only includes cases for SelexolTM with separate capture of impurities, supplementary calculations were carried for the remaining cases by performing mass and energy balances, and economic calculations were performed for the remaining cases, overwriting the IECM SelexolTM base case. The impact of different fuels on costs and CO₂ purity has also been explored. In all of the cases the IGCC plant uses aGE entrained-flow slurry fed gasifier. This gasifier was chosen since a number of studies have indicated that for bituminous coals, they offer the lowest capital costs (Holt, 2003; IEAGHG, 2003; IEAGHG, 2004a).

3.2 Pre-combustion capture process scenarios

3.2.1 SelexolTM with separate capture of sulfur species and CO₂

This case is based on an IGCC plant that has one full size GE quench gasifier with one spare, one gas turbine with a respective heat recovery steam generator (HRSG), and a steam turbine. The syngas produced by the gasifier comprises mainly CO (38%) and H₂ (34%), with the remainder being made up of CO₂ (15%), H₂O (10%), with smaller amounts of N₂ (0.90%), Ar (0.87%), CH₄ (0.56%), H₂S (0.56%), COS (0.03%), NH₃ (0.01%) and HCl (0.01%). The syngas is steam shifted in high temperature and then low temperature reactors which convert most of the CO to CO₂ and H₂. The shifted syngas is scrubbed in a SelexolTM plant to yield a H₂ rich syngas and an acid gas stream that is processed in a Claus/Beavon-Stretford plant for sulfur recovery. In the SelexolTM plant, 95% of the CO₂ contained in the syngas is captured and compressed to 120 bar. Capture rate in pre-combustion plants may vary between 50 - 98 %. The hydrogen rich fuel gas is moisturised with water before entering the gas turbine. The plant has a net power output of 265 MW.

3.2.2 Rectisol® with separate capture of sulfur species and CO₂

The Rectisol® process employs chilled methanol as a solvent to purify syngas and operates at very low temperatures between -40 °C and -60 °C. The process is also more complex compared to others involving solvents like Selexol™, but ensures very deep H₂S removal rates down to single figure ppm_v levels. There are many possible process configurations for this technology depending on the gas cleaning requirements. In a process configuration described by Padurean et al. (2012), a high level of both CO₂ and H₂S removal is required. The syngas is cooled to -30 to -40 °C before it enters the first absorption column where Rectisol®, that is pre-loaded with CO₂, selectively removes H₂S. The H₂S rich solution leaves the bottom of the absorber and is regenerated by first flashing at medium pressure to recover useful syngas, which is then recycled back to the H₂S absorber, and then by heating to boiling temperature and stripping with methanol vapour. The stripper acid gas stream, consisting of over 95% H₂S, is sent to the Claus plant for elemental sulfur recovery. The desulfurised gas enters the CO₂ absorber for CO₂ removal. The rich CO₂ solution leaving the absorber is regenerated in a flash regenerator (Kohl and Nielsen, 2005). Limited information relating to the technical and economic details of the process are available in the literature, although two notable modelling studies have been published by Sun and Smith (2013) and by Padurean et al. (2012). Technical parameters for energy requirements used to model the process are those provided by Padurean et al. (2012) for a specific power consumption (0.144 MJ/kgCO₂), specific cooling consumption (0.081 MJ/kgCO₂) and specific heating consumption (0.35 MJ/kgCO₂). Sources of costs include a presentation dated October 2003 by Eastman Gasification Services entitled “Coal Gasification – Today’s Technology of Choice and Tomorrow’s Bright Promise” which reported estimated capital costs of \$20 million for Selexol™ and \$40 million for Rectisol®. Plant size was not given, but the cost factor of two in estimating the difference between Selexol™ and Rectisol® is helpful (EPA, 2006). Similar cost factor differences between Selexol™ and Rectisol® plants for Ammonia production have been reported by Fluor and UOP (Mak et al., 2004). In the present calculations, it has been assumed that Rectisol® plant equipment costs are a factor two higher than the ones reported by IECM for Selexol™ plants. The presented CO₂ composition is based on a recent report by North West Redwater Partnership (Heal and Kemp, 2013).

3.2.3 Selexol™ with separate co-capture of sulfur species and CO₂

The overall power plant for this case is similar to the Selexol™ plant with separate capture, with the main difference being that the CO₂ and H₂S are removed from the fuel gas simultaneously in a single stage, thereby eliminating the need for the sulfur removal and processing equipment. The absorption plant configuration is less complex than the separate capture case, consisting of a single CO₂-H₂S absorber, a two stage glycol flash and an acid gas stripper for simultaneous CO₂ and H₂S recovery. The CO₂ capture level remains at 95%, while the H₂S removal is 94%. The CO₂ product stream is compressed to an export pressure of 120 bar as with the other cases. Energy requirements for the co-capture Selexol™ plant are assumed to be a factor 3.8 lower than the separate capture Selexol™ plant on the basis of calculations by Ordorica-Garcia et al. (2006). Although this is an approximation since the calculations by Ordorica-Garcia et al. were performed for plants with 2 gas turbines, total separation energy is likely to scale with amount of processed material. The concentrations of sulfur species are calculated based on the mass balance and process assumptions, whereas concentrations of other impurities are based on literature sources since the IECM does not describe their behaviour; IEAGHG (2004b) for CO, H₂, H₂O, N₂, and E.C. (2011) for CH₄, NH₃, HCl and Ar.

3.3 Impact of pre-combustion scenario selection on overall plant costs and CO₂ purity

In this section, the technical and economic results of the modelling of IGCC plants with the different pre-combustion capture options noted in Sections 3.2.1 to 3.2.3 are presented. Each case is based on the use of a single GE 7FB gas turbine and one GE slurry fed entrained gasifier with one spare. The calculations refer to new build plants since although pre-combustion capture retrofits to IGCC plants are technically feasible, their number is expected to be limited since only a handful of prototype IGCC plants are currently operating. Financial data used in all cases are the same as those used for the oxyfuel combustion capture analysis. Details of the technical and financial assumptions are summarised in Table 5.

Table 5. Key assumptions for the pre-combustion capture plants.

Parameter	Selexol™ separate capture*	Selexol™ co-capture*,**	Rectisol® separate capture*,**
Fuel	Low sulfur bituminous coal†	Low sulfur bituminous coal†	Low sulfur bituminous coal†
Gross Power Output (MW)	343.3	343.3	343.3
Net Power Output (MW)	268.7	295.2	259.6
Net Plant Efficiency, HHV (%)	30.78	33.83	29.73
Capacity Factor (%)	96.5	96.5	96.5
Fixed Charge Factor (%)	17.21	17.21	17.21
Fuel Price (€/GJ, HHV)	1.75	1.75	1.75
CO ₂ Capture Efficiency (%)	95.0	95.0	95.0

* Based on GE quench gasifier (1+1 spare), 1 GE 7FB gas turbine.

** 98% sulfur removal efficiency via hydrolyser and physical solvent system; sulfur recovery via Claus and Beavon-Stretford plants.

† As-fired properties are: 71.74 wt% C, 4.62 wt% H, 6.09 wt% O, 0.07 wt% Cl, 0.64 wt% S, 9.79 wt% ash, 5.63 and 30.42 MJ kg⁻¹ HHV.

Table 6 summarises the major results of the analysis of pre-combustion capture plants. The Rectisol® plant has the highest CO₂ emission rate, followed by the separate capture Selexol™ plant. The Selexol™ co-capture plant has the lowest LCOE. With CO₂ capture, all three plants remove 95% of the CO₂, being subject to an energy penalty in each case. In IGCC technologies, Table 6 also shows that the cost of CO₂ avoided is highest for the Rectisol® plant. The capital cost of the IGCC plant with a separate capture Rectisol® system is estimated to be 10% higher than the equivalent Selexol™ system. Due to the lower capital cost as well as higher plant efficiency, the LCOE for the co-capture Selexol™ system is projected to be 15% less than the Selexol™ separate capture case. There are some uncertainties in the capture plant estimates for Rectisol® systems which could be quantified and analysed in future work. Nevertheless, the initial analysis given here shows that IGCC plants with CO₂ capture can be cost competitive when compared to oxyfuel power plants to provide relatively high purity CO₂.

Table 6. Results of techno-economic calculation for the pre-combustion plant cases.

Parameter	Selexol™ separate capture	Selexol™ co-capture	Rectisol® separate capture
CO ₂ Emission Rate (kg/MWh)	95.18	86.63	98.55
CO ₂ Captured (kg/MWh)	885.3	806.7	916.3
Total Capital Required (€/kW-net)	4125	3490	4764
Total O&M Costs (M €/yr)	93.90	90.08	99.10
Cost of Electricity* (€/MWh)	125.2	107.1	142.03
Cost of CO ₂ Avoided ** (€/tonne CO ₂)	46.49	21.73	67.22
Product Stream Composition:			
CO ₂	97.91 mol% [†]	97.64 mol% [†]	99.51 mol% ^{††}
CO	0.2 mol% ^{††}	0.2 mol% ^{††}	0.073 mol% ^{††}
H ₂	1.8 mol% ^{††}	1.7 mol% ^{††}	0.295 mol% ^{††}
CH ₄	112 ppm _v ^{††}	112 ppm _v ^{††}	980 ppm _v ^{††}
H ₂ S	72 ppm _v [‡]	3794 ppm _v [‡]	1.5 ppm _v ^{††}
COS	trace [‡]	1 ppm _v [‡]	0 ^{††}
NH ₃	38 ppm _v ^{††}	38 ppm _v ^{††}	-
HCl	17.5 ppm _v ^{††}	17.5 ppm _v ^{††}	-
H ₂ O	300 ppm _v ^{††}	300 ppm _v ^{††}	0 ^{††}
N ₂	200 ppm _v ^{††}	200 ppm _v ^{††}	50 ppm _v ^{††}
Ar	200 ppm _v ^{††}	200 ppm _v ^{††}	40 ppm _v ^{††}
Methanol	-	-	160 ppm _v ^{††}

All costs in constant 2014 Euros.

* Levelised cost excluding tax on emissions and cost of CO₂ transport and storage.

** All avoided cost values are relative to a reference plant without CO₂ capture for the same system.

[†] Balance.

^{††} Assumed on the basis of literature studies (E.C., 2011; Heal and Kemp, 2013; IEAGHG, 2004b).

[‡] Calculated via IECM.

4. ANALYSIS OF POST-COMBUSTION CARBON CAPTURE WITH RESPECT TO COST AND CO₂ IMPURITIES

In this section the costs and CO₂ purity levels associated with post-combustion carbon capture are analysed. Post-combustion capture (PCC) can be applied to plants that run on various fuels, but the application to coal utilisation using standard monoethanolamine solutions for CO₂ absorption is presented here. Commercial amine based solvents such as Econamine FG Plus can offer improved process efficiencies, impacting on overall costs and so cross comparative studies of solvent performance are warranted. Additional environmental control techniques were also considered in the modelling, including in-furnace NO_x control, electrostatic precipitator particulate separation units, hot-side selective catalytic reduction (SCR) for further NO_x control and flue gas desulfurisation units for SO_x removal.

4.1 Modelling methods and assumptions

To account for the many factors that affect the power output, cost of electricity, emissions and cost of PCC-CCS plants, the IECM model is again used to perform the techno-economic calculations. These cases are in parity with the oxyfuel combustion plants presented in Section 2, with all of the same technical and financial assumptions, but with the fundamental difference being the choice of capture technology. In each case, the plant is a 400 MW gross power output facility with carbon capture; however in the PCC case, the base plant size is larger compared to the oxyfuel case because of the increased energy requirement for amine steam use. The associated energy penalty of carbon capture results in a plant with reduced net plant electrical power output.

4.2 Post-combustion capture process scenarios

Details of the assumptions used for the post-combustion capture scenarios are summarised in Table 7. Two scenarios are considered: a process plant that has all the aforementioned environmental control techniques (in-furnace NO_x controls, ESP, SCR and FGD) and a similar case but with the SCR and FGD process areas removed. In both cases an SO₂ polisher is used to further limit the sulfur levels of the flue gas to low levels (<10 ppmv) on entry to the post-combustion capture plant. This is to prevent excessive amine loss due to the formation of heat stable salts from the combination of SO₂ with the amine, and also has the added benefit of reducing other impurities. To maintain parity with the oxyfuel cases, the costs given in this section refer to retrofitted plants, with the total capital required for non-CCS plant areas amortised by 25%.

Table 7. Key assumptions for the post-combustion capture plants.

Parameter	ESP particulate control only*	With NO _x control by LNB/SCR and SO ₂ control by Wet-FGD **
Fuel	Low sulfur bituminous coal [†]	Low sulfur bituminous coal [†]
Gross Power Output (MW)	400	400
Net Power Output (MW)	321.6	313.8
Net Plant Efficiency, HHV (%)	25.95	25.66
Capacity Factor (%)	96.5	96.5
Fixed Charge Factor (%)	17.21	17.21
Fuel Price (€/GJ,HHV)	1.75	1.75
CO ₂ Capture Efficiency (%)	90	90

* Supercritical boiler; electrostatic precipitator particulate control system included.

**Supercritical boiler; electrostatic precipitator particulate control system, in-furnace NO_x controls, hot-side SCR and wet FGD SO₂ control included.

[†] As-fired properties are: 71.74 wt% C, 4.62 wt% H, 6.09 wt% O, 0.07 wt% Cl, 0.64 wt% S, 9.79 wt% ash, 5.63 and 30.42 MJ kg⁻¹ HHV.

4.3 Post-combustion plant costs and CO₂ purity

Table 8 summarises the major results of the analysis of the post-combustion CO₂ capture plants. Performance data for the plants with and without the additional environmental controls are somewhat similar, with CO₂ emission rates around 120 kg/MWh. The plant with additional environmental controls has a slightly higher capture rate than the one without due to its lower net plant efficiency. As expected, the capital costs for the plant with additional environmental controls are higher due to the extra equipment required; however, the total O&M costs are higher for the plant without environmental controls due to the impact of higher concentrations of flue gas impurities on the CO₂ capture plant. The cost of electricity for the plant with the additional environmental controls is higher than for that without due to the capital costs of the additional equipment whose operation results in a modest increase in calculated CO₂ purity due to the reduction of HCl and NO₂ in the CO₂ product stream. Some literature studies also report low levels of air contaminants, moisture and carbon monoxide in post-combustion capture derived streams (E.C., 2011).

Table 8. Results of techno-economic calculation for the post-combustion capture plant cases.

Parameter	ESP particulate control only	With NO_x control by LNB/SCR and SO₂ control by Wet-FGD
CO ₂ emission rate (kg/MWh)	119.8	121.6
CO ₂ captured (kg/MWh)	1078	1094
Total capital required (€/kW-net)	3204	3572
Total O&M costs (M €/yr)	147.1	142.8
Cost of electricity* (€/MWh)	119.3	126.5
Cost of CO ₂ avoided ** (€/tonne CO ₂)	102.1	100.2
Product stream Composition [†]		
CO ₂	99.95 mol%	99.99 mol%
HCl	349 ppm _v	35 ppm _v
SO ₂	83 ppm _v	91 ppm _v
SO ₃	11 ppm _v	11 ppm _v
NO ₂	38 ppm _v	10 ppm _v

All costs in constant 2014 Euros.

* Levelised cost excluding tax on emissions and cost of CO₂ transport and storage.

** All avoided cost values are relative to a reference plant without CO₂ capture for the same system.

[†] Calculated via IECM.

5. DISCUSSION

This paper has presented a techno-economic analysis of different carbon capture technologies with varying levels of refinement of the CO₂ product stream, considering the three leading technologies proposed for capture from the power generation sector, namely; oxyfuel combustion, pre-combustion and post-combustion CO₂ capture. The analysis was performed using a combination of modelling with Aspen HYSYS and the Integrated Environmental Control Model, and information available from literature sources. This enabled the calculation of key performance parameters for several power plant process configurations that impact the CO₂ product purity level, in addition to capital and O&M costs and ultimately the levelised cost of electricity of individual scenarios.

The specific capital costs for the range of CO₂ capture technologies and scenarios considered can be broken down by overall process area, as illustrated Figure 2. The oxyfuel compression and dehydration scenario has a similar capital cost to the slightly more complex double flash case, due partly to the need for larger compressors in the compression and dehydration case caused by the higher flow rate of CO₂ product. The CO₂ control area for the oxyfuel distillation has a higher capital cost due to the higher cost of the distillation column. In the pre-combustion cases, capital expenditure progressively increases when sulfur control is added and when the more expensive Rectisol[®] system is used, leading to this latter technology being the most expensive of all the scenarios considered at 4764 €/kW-net. In the

post-combustion power plant scenarios, capital expenditure is added with the additional conventional pollution control devices. The post-combustion capture scenario without the assortment of conventional pollution control devices was found to have the lowest capital cost at 3204 €/kW-net.

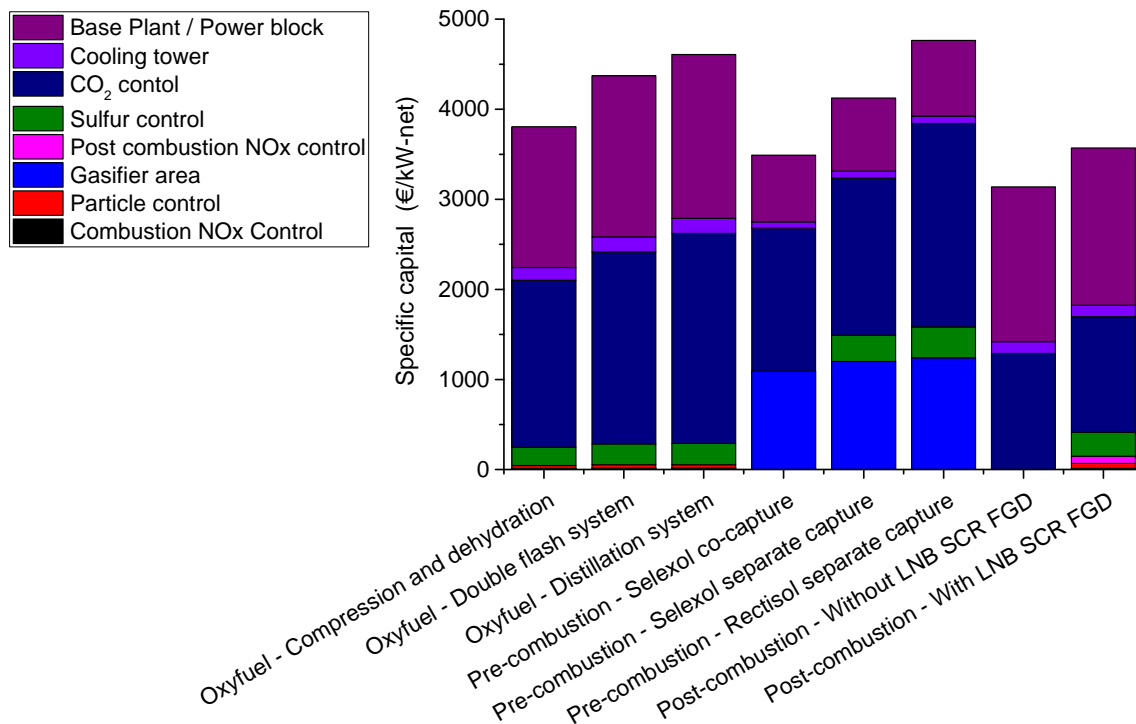


Figure 2. Specific capital required (constant 2014 €/kW-net) for the different CO₂ capture technologies and purification scenarios.

Total O&M costs for the different CO₂ capture technologies and scenarios considered in this study are shown in Figure 3. The pre-combustion capture scenarios have the lowest O&M costs that scale with CO₂ impurity, due to the costs of operating sulfur capture plants and the higher operational costs of the cold methanol Rectisol[®] process. The oxyfuel combustion capture scenario O&M costs are slightly higher than those of the pre-combustion capture cases, with the distillation case being the highest amongst them due to it being the most energy intensive cryogenic separation. Out of the post-combustion cases, the scenario without most of the conventional pollution control devices has slightly higher O&M costs due to the increased solvent degradation caused by impurities, resulting in this technology having the highest total O&M cost out of all the cases in this study.

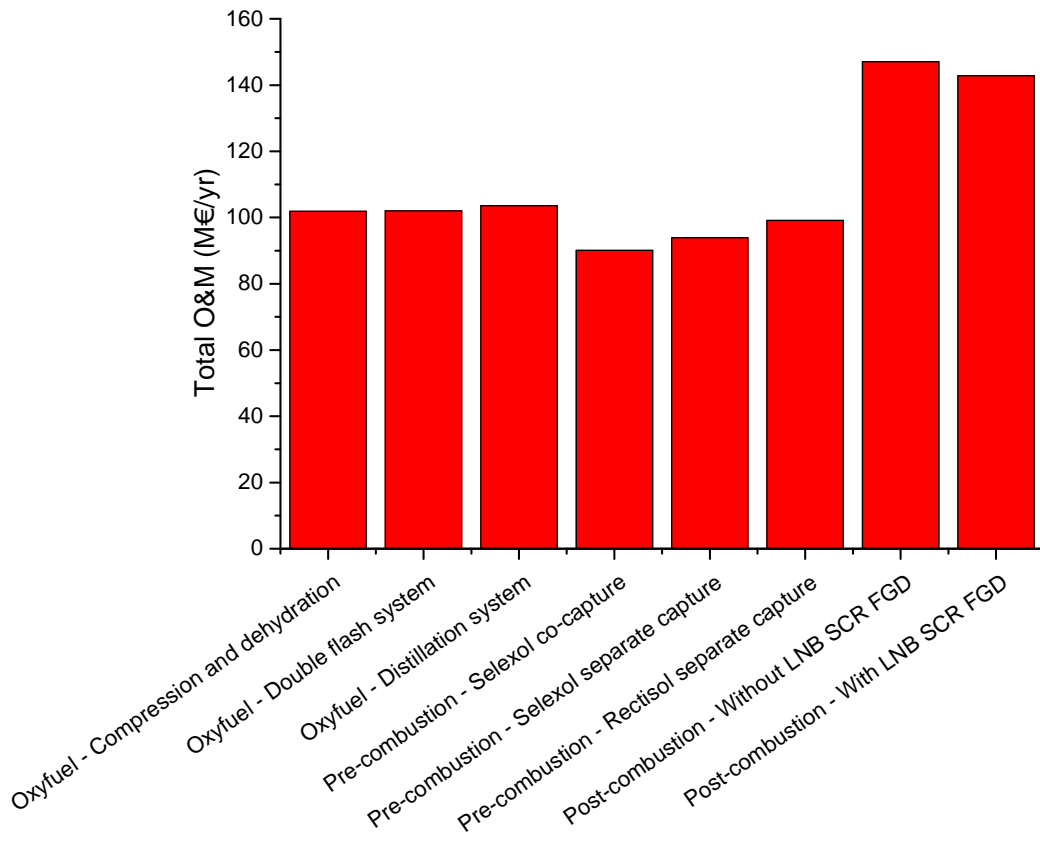


Figure 3. Total O&M costs (millions of constant 2014 € per year) for the different CO₂ capture technologies and purification scenarios.

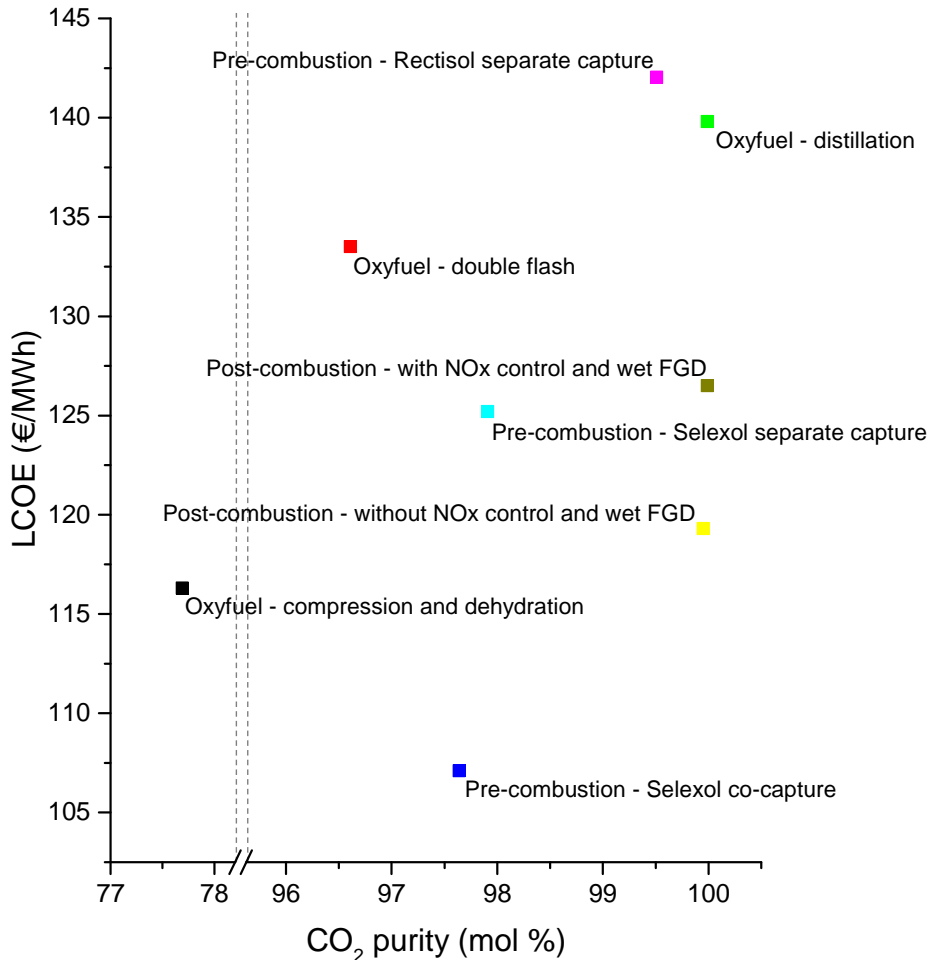


Figure 4. Cost of electricity (constant 2014 €/MWh) versus CO₂ purity for different CO₂ capture technologies using a low-sulfur bituminous coal.

Figure 4 illustrates the trade-off between cost and purity of the captured CO₂ stream in the analysed cases. The technology with the lowest LCOE is pre-combustion capture using the SelexolTM physical solvent with co-capture of impurities. This technology produces CO₂ with an estimated purity of 97.64 mol%, but high estimated levels of H₂S (at 3974 ppmv). Conversely, the highest cost technology in this analysis is found to be pre-combustion capture using Rectisol[®] as the solvent and with separate capture of sulfur impurities. The CO₂ stream produced by this technology is dry, with low levels of other contaminants such as CO and H₂. The technologies that produce the highest grade of CO₂ are post-combustion capture with NO_x and wet FGD environmental control, and oxyfuel combustion plant with CO₂ purification by distillation, with both producing 99.99 mol% CO₂ product, but with post-combustion capture having the lowest cost. The three analysed oxyfuel combustion capture technologies produce the widest range of CO₂ purity, with the compression and dehydration

only system, that does not include any additional purification of the raw CO₂ flue gas stream, producing the lowest grade CO₂ stream that contains 77.69 mol% CO₂ and high levels of non-condensable species (O₂, N₂ and Ar), plus acid gas species. Bassi et al. (2015) have recently outlined a range of cost estimates for CCS from selected literature sources. LCOEs of coal-fired plants in the literature review averaged from about 80-210 €/MWh with an average of 115 €/MWh which is somewhat lower than the average LCOE of the scenarios presented in this study of 126 €/MWh that exclude transport and storage costs. This may be a reflection of the fuel price use in our study.

While the costs given in this analysis are current at the date of publication, it should be borne in mind that as each of the presented technologies mature their costs are likely to decrease at potentially different rates. The current analysis has focussed on the main process performance factors that are likely to affect CO₂ purity; final CO₂ processing in the cases of oxyfuel combustion and pre-combustion capture, and upstream process configuration for the case of post-combustion capture. However, there are other factors that can affect cost and also CO₂ product purity, including plant size, fuel selection, retrofit versus new build, and mode of operation of the power plant. While the analysis has focussed on retrofitted plants for oxyfuel combustion and post-combustion capture, and new-build plants for pre-combustion capture, future comparisons of retrofitted and new-build plants for similar technologies are recommended. Although gas-fired power plants were not considered in the analysis, the application of post-combustion capture to this type of power generation is likely to produce electricity at even lower cost and with high CO₂ product purity. The selection of appropriate carbon capture technology will be influenced by whole chain CCS techno-economics, legal, environmental, and health and safety considerations. For example, in some countries where acid gas injection is commonly practiced, pre-combustion capture with co-capture of impurities may be acceptable, and the most cost-effective solution when coupled to enhanced oil recovery CO₂ storage applications. Scope for CCS cost reduction through relaxing CO₂ purity limits from capture source may also exist when a collection of CCS plants connect to a shared CO₂ transport network infrastructure (Kolster et al., in prep.). For example, if lower purity sources are mixed with higher purity sources this may provide a final CO₂ stream of quality that is suitable for the geological storage site. Furthermore, where distance from the capture source is short, higher levels of impurities may be permissible if internal pipeline surfaces are protected from corrosion, for example, by using stainless steel (Sim et al., 2014).

The present study should facilitate further analysis of whole CCS chain techno-economics and process configuration.

6. Concluding Remarks

A techno-economic modelling study of power plants with CO₂ capture technologies which focusses on process scenarios that deliver different degrees of CO₂ stream purity has been carried out. The three leading CO₂ capture technologies for the power sector were considered, namely; oxyfuel combustion, pre-combustion and post-combustion capture. The study uses a combination of process simulation of flue gas cleaning processes, modelling with a power plant cost and performance calculator and literature values of key performance criteria in order to calculate capital costs, operational and maintenance costs, the levelised cost of electricity and CO₂ product purity of the considered CO₂ capture options .

For oxyfuel combustion capture, the calculations are based on a 400 MWg retrofitted power station that uses a low sulfur coal and considers three raw CO₂ flue gas processing strategies of compression and dehydration only, double flash system purification and distillation purification. Analysis of pre-combustion capture options is based on new build integrated gasification combined cycle plants with one gas-turbine and a GE entrained-flow gasifier. Integrated physical solvent systems for capturing CO₂ and sulfur species were considered in three ways; co-capture of sulfur impurities with the CO₂ stream using SelexolTM solvent or separate capture of CO₂ and sulfur impurities using either SelexolTM or Rectisol[®] solvent systems. Analysis of post-combustion capture plants was made with and without some conventional pollution control devices.

Of the different cases considered, pre-combustion capture with co-capture of impurities and CO₂ using SelexolTM offered the lowest cost with a reasonably high purity of CO₂ at 97.64 mol%, but high estimated levels of H₂S (at 3974 ppmv) in the captured stream. The most expensive system was pre-combustion capture using Rectisol[®] with separate capture of CO₂ and sulfur impurities, producing a dry 99.51 mol% pure CO₂ stream. The system with the lowest grade of CO₂ was oxyfuel combustion capture with compression and dehydration of the raw CO₂ stream only, which resulted in 77.69 mol% pure CO₂ and with the second lowest cost. The oxyfuel plant with a distillation purification system and a post-combustion capture

plant with conventional pollution control devices had the joint highest CO₂ purity (99.99 mol%), with the post-combustion capture system estimated to be the cheaper of the two. The calculations performed are of use in further analyses of whole chain CCS for the safe and economic capture, transport and storage of CO₂.

7. Acknowledgments

The research leading to the results contained in this paper received funding from the European Union 7th Framework Programme FP7-ENERGY-2012-1 under grant number 309102. The paper reflects only the authors' views and the European Union is not liable for any use that may be made of the information contained herein.

8. References

Aboudheir, A., McIntyre, G., 2008. Industrial design and optimization of CO₂ capture, dehydration and compression facilities, 87th Annual GPA Convention, Grapevine, USA, 2008.

Al-Qayim, K., Nimmo, W., Pourkashanian, M., 2015. Comparative techno-economic assessment of biomass and coal with CCS technologies in a pulverized combustion power plant in the United Kingdom. *Int. J. Greenh. Gas Con.* 43, 82-92.

Bassi, S., Boyd, R., Buckle, S., Fennell, P., Mac Dowell., Makuch., Z., Stafell, I., 2015. Bridging the gap: improving the economic and policy framework for carbon capture and storage in the European Union, Policy Brief, Grantham Institute.

Boot-Handford, M.E., Abanades, J.C., Anthony, E.J., Blunt, M.J., Brandani, S., MacDowell, N., Fernández, J.R., Ferrari, M.C., Gross, R., Hallett, J.P., Haszeldine, R.S., Heptonstall, P., Lyngfelt, A., Makuch, Z., Mangano, E., Porter, R.T.J., Pourkashanian, M., Rochelle, G.T., Shah, N., Yao, J.G., Fennell, P.S., 2014. Carbon capture and storage update. *Energy Environ. Sci.* 7, 130-189.

Catalanotti, E., Hughes, K.J., Porter, R.T.J., Price, J., Pourkashanian, M., 2014. Evaluation of performance and cost of combustion-based power plants with CO₂ capture in the United Kingdom. *Environ. Prog. Sustain. Energy* 33, 1425-1431.

CO₂PIPETRANS, 2008. CO₂Pipeline Transport, CO₂PIPETRANS Project Web-site http://www.dnv.com/industry/oil_gas/services_and_solutions/technicaladvisory/process_integrity/ccs_carbon_capture_storage/co2pipetrans/Index.asp (accessed: 31.07.14).

CO₂QUEST, 2015. Impact of the quality of CO₂ on storage and transport. Accessed: 01/07/15, CO₂QUEST Project Website. <http://www.co2quest.eu/>

de Visser, E., Hendriks, C., Barrio, M., Mølnvik, M.J., de Koeijer, G., Liljemark, S., Le Gallo, Y., 2008. Dynamic CO₂ quality recommendations. *Int. J. Greenh. Gas Control* 2, 478-484.

Dillon, D.J., White, V., Allam, R.J., Wall, R.A., Gibbins, J., 2005. Oxy-combustion processes for CO₂ capture from power plant. IEA Greenhouse Gas R&D Programme, E/04/031.

E.C., 2011. Implementation of Directive 2009/31/EC on the geological storage of carbon dioxide. Guidance document 2: Characterisation of the storage complex, CO₂ stream-composition, monitoring and corrective measures. ISBN-13 978-92-79-19834-2.

Edge, P., Gharebaghi, M., Irons, R., Porter, R., Porter, R.T.J., Pourkashanian, M., Smith, D., Stephenson, P., Williams, A., 2011. Combustion modelling opportunities and challenges for oxy-coal carbon capture technology. *Chem. Eng. Res. Des.* 89, 1470-1493.

Eggers, R., Köpke, D., 2008. Phase equilibria measurements and their application for the CO₂ separation from CO₂ rich gases, 3rd IEAGHG International Oxy-fuel Combustion Research Network, Yokohama, Japan.

Ekström, C., Schwendig, F., Biede, O., Franco, F., Haupt, G., de Koeijer, G., Papapavlou, C., Røkke, P.E., 2009. Techno-economic evaluations and benchmarking of precombustion CO₂ capture and oxy-fuel processes developed in the European ENCAP project. *Energy Procedia* 1, 4233-4240.

EPA, 2006. Nexant and Cadmus Group, Environmental footprints and costs of coal-based integrated gasification combined cycle and pulverized coal technologies, EPA-430/R-06/006, US Environmental Protection Agency, Washington DC, USA.

Farret, R., 2015. Report with definition of a methodology addressing both environmental and safety concerns, INERIS, EC CO₂QUEST Project Number 309102, Work Package 5, Deliverable 5.2, Technical Report.

Goto, K., Yogo, K., Higashii, T., 2013. A review of efficiency penalty in a coal-fired power plant with post-combustion CO₂ capture. *Appl. Energ.* 111, 710-720.

Grol, E., Black, J., Haslbeck, J., Jones, A.P., Lundberg, W., Shah, V., Kyle, A., Lewis, E., Gerdes, K., 2011. Cost and performance of PC and IGCC plants for a range of carbon dioxide capture, US DOE, DOE/NETL 2011/1498.

Heal, K., Kemp, T., 2013. Carbon capture through innovative commercial structuring in the Canadian oil sands: A project overview of the North West Sturgeon Refinery, North West Redwater Partnership.

Hegy, S., Glagola, J., Tremblay, D., McCarthy, D., 2013. Jump Start: Activated Economics in Aspen HYSYS V8.4, Aspen Technology, Inc AspenTech.

Holt, N., 2003. EPRI, A summary of recent IGCC studies of CO₂ capture for sequestration”, Gasification Technologies Conference, San Francisco, DC.

IEAGHG, 2003. Potential for improvements in gasification combined cycle power generation with CO₂ capture. Report PH4/19,

IEAGHG, 2004a. Canadian clean power coalition – Studies on CO₂ capture and storage. report PH4/27,

IEAGHG, 2004b. Impact of impurities on CO₂ capture, transport and storage. Report PH4/32.

IEAGHG, 2011. Effects of impurities on geological storage of CO₂. Report 2011/04.

IECM, 2015. Dept. of Engineering and Public Policy, Carnegie Mellon University, Integrated environmental control model (IECM). Technical documentation, IECM v.9.0.1, Pittsburgh, USA (<http://www.iecm-online.com>).

Kather, A., Kownatzki, S., 2011. Assessment of the different parameters affecting the CO₂ purity from coal fired oxyfuel process. *Int. J. Greenh. Gas Con.* 5S, S204-S209.

Kohl, A., Nielsen, R., 2005. Gas Purification, 5th Ed., Gulf Publishing Company, Houston.

Kolster, C., Mechleri, E., Krevor, S., Mac Dowell, N., in preparation. The role of CO₂ purification and transport networks in carbon capture and storage cost reduction. *Int. J. Greenhouse Gas Control. In preparation.*

Lee, J.Y., Keener, T.C., Yang, Y.J., 2009. Potential flue gas impurities in carbon dioxide streams separated from coal-fired power plants. *J. Air Waste Manag. Assoc.* 59, 725-732.

Li, H., Yan, J., Yan, J., Anheden, M., 2009. Impurity impacts on the purification process in oxy-fuel combustion based CO₂ capture and storage system. *Appl. Energy* 86, 202-213.

Mak, J.Y., Heaven, D., Kubek, D., Sharp, C., Clark, M., 2004. Synthesis gas purification in gasification to ammonia/urea complex, Gasification Technologies Conference, Washington DC, USA.

Matuszewski, M., Woods, M., 2012. Quality guidelines for energy system studies - CO₂ impurity design parameters. NETL, DOE/NETL-341/011212.

Mohammed, I.Y., Samah, M., Mohamed, A., Sabina, G., 2014. Comparison of SelexolTM and Rectisol[®] ytechnologies in an integrated gasification combined cycle (IGCC) plant for clean energy production. *Int. J. Eng. Res.* 3, 742-744.

NIST, 2011. NIST Chemistry WebBook (<http://webbook.nist.gov/chemistry/>).

Ordorica-Garcia, G., Douglas P., Croiset, E., Zheng, L., 2006. Technoeconomic evaluation of IGCC power plants for CO₂ avoidance. *Energ. Convers. Manage.* 47, 2250-2259.

Padurean, A., Cormos, C., Agachi, P., 2012. Pre-combustion carbon dioxide capture by gas-liquid absorption for integrated gasification combined cycle power plants. *Int. J. Greenh. Gas Control* 7, 1-11, 2012.

Parsons Brinckerhoff 2012, Electricity generation cost model - 2012 update of non-renewable technologies, Department of Energy and Climate Change, August 2012.

Pipitone, G., Bolland, O., 2009. Power generation with CO₂ capture: Technology for CO₂ purification. *Int. J. Greenh. Gas Con.* 3, 528-534.

Porter, R.T.J., Fairweather, M., Pourkashanian, M., Woolley, R.M., 2015. The range and level of impurities in CO₂ streams from different carbon capture sources. *Int. J. Greenh. Gas Control* 36, 161-174.

Posch, S., Haider, M., 2012. Optimization of CO₂ compression and purification units (CO₂CPU) for CCS power plants. *Fuel* 101, 254-263.

Rao, A.B., Rubin, E.S., 2006. Identifying cost-effective CO₂ control levels for aminebased CO₂ capture systems. *Ind. Eng. Chem. Res.* 45, 2421-2429.

Rubin, E.S., Rao, A.B., Chen, C., 2005. Comparative assessments of fossil fuel power plants with CO₂ capture and storage. In: Rubin, E.S., Keith, D.W., Gilboy, C.F. (Eds.), *Proceedings of Seventh International Conference on Greenhouse Gas Control Technologies, Vol. I: Peer-Reviewed Papers and Overviews*. Elsevier Ltd., pp. 285-293.

Rubin, E.S., Chen, C., Rao, A.B., 2007. Cost and performance of fossil fuel power plants with CO₂ capture and storage, *Energy Policy*, 35, 4444-4454.

Rubin, E.S., Davison, J.E., Herzog, H.J., 2015. The cost of CO₂ capture and storage. *Int. J. Greenh. Gas Control*, 378-400.

Schach, M.O., Schneider, R., Schramm, H., Repke, J.U., 2010. Techno-economic analysis of postcombustion processes for the capture of carbon dioxide from power plant flue gas. *Ind. Eng. Chem. Res.* 49, 2363-2370.

Seepana, S., Jayanti, S., 2012. Optimized enriched CO₂ recycle oxy-fuel combustion for high ash coals. *Fuel* 102, 32-40.

Sim, S., Cole, I.S., Choi, Y.-S., Birbilis, N., 2014. A review of the protection strategies against internal corrosion for the safe transport of supercritical CO₂ via steel pipelines for CCS purposes. *Int. J. Greenh. Gas Control* 29, 185-189.

Sun, L., Smith, R., 2013. Rectisol wash process simulation and analysis. *J. Clean. Prod.* 39, 321-328.

Tan, Y., Croiset, E., Douglas, M.A., Thambimuthu, K.V., 2006. Combustion characteristics of coal in a mixture of oxygen and recycled flue gas. *Fuel* 85, 507-512.