



Deposited via The University of Sheffield.

White Rose Research Online URL for this paper:

<https://eprints.whiterose.ac.uk/id/eprint/163129/>

Version: Published Version

---

**Article:**

Omehia, K.C., Clements, A.G., Michailos, S. et al. (2020) Techno-economic assessment on the fuel flexibility of a commercial scale combined cycle gas turbine integrated with a CO<sub>2</sub> capture plant. *International Journal of Energy Research*, 44 (11). pp. 9127-9140. ISSN: 0363-907X

<https://doi.org/10.1002/er.5681>

---

**Reuse**

This article is distributed under the terms of the Creative Commons Attribution (CC BY) licence. This licence allows you to distribute, remix, tweak, and build upon the work, even commercially, as long as you credit the authors for the original work. More information and the full terms of the licence here:


<https://creativecommons.org/licenses/>

**Takedown**

If you consider content in White Rose Research Online to be in breach of UK law, please notify us by emailing [eprints@whiterose.ac.uk](mailto:eprints@whiterose.ac.uk) including the URL of the record and the reason for the withdrawal request.



# Techno-economic assessment on the fuel flexibility of a commercial scale combined cycle gas turbine integrated with a CO<sub>2</sub> capture plant

Kelachi C. Omehia | Alastair G. Clements | Stavros Michailos  |  
Kevin J. Hughes | Derek B. Ingham | Mohamed Pourkashanian

Energy 2050, Department of Mechanical Engineering, University of Sheffield, Sheffield, UK

## Correspondence

Kevin J. Hughes, Energy 2050, Department of Mechanical Engineering, University of Sheffield, Sheffield, S3 7RD, UK.  
Email: k.j.hughes@sheffield.ac.uk

## Summary

Post-combustion carbon capture is a valuable technology, capable of being deployed to meet global CO<sub>2</sub> emissions targets. The technology is mature and can be retrofitted easily with existing carbon emitting energy generation sources, such as natural gas combined cycles. This study investigates the effect of operating a natural gas combined cycle plant coupled with carbon capture and storage while using varying fuel compositions, with a strong focus on the influence of the CO<sub>2</sub> concentration in the fuel. The novelty of this study lies in exploring the technical and economic performance of the integrated system, whilst operating with different fuel compositions. The study reports the design of a natural gas combined cycle gas turbine and CO<sub>2</sub> capture plant (with 30 wt % monoethanolamine), which were modelled using the gCCS process modelling application. The fuel compositions analysed were varied, with focus on the CO<sub>2</sub> content increasing from 1% to 5%, 7.5% and 10%. The operation of the CO<sub>2</sub> capture plant is also investigated with focus on the CO<sub>2</sub> capture efficiency, specific reboiler duty and the flooding point. The economic analysis highlights the effect of the varying fuel compositions on the cost of electricity as well as the cost of CO<sub>2</sub> avoided. The study revealed that increased CO<sub>2</sub> concentrations in the fuel cause a decrease in the efficiency of the natural gas combined cycle gas turbine; however, rising the CO<sub>2</sub> concentration and flowrate of the flue gas improves the operation of the capture plant at the risk of an increase in the flooding velocity in the column. The economic analysis shows a slight increase in cost of electricity for fuels with higher CO<sub>2</sub> contents; however, the results also show a reduction in the cost of CO<sub>2</sub> avoided by larger margins.

## KEYWORDS

economic analysis, fuel flexibility, natural gas combined cycle, post-combustion capture

This is an open access article under the terms of the Creative Commons Attribution License, which permits use, distribution and reproduction in any medium, provided the original work is properly cited.

© 2020 The Authors. *International Journal of Energy Research* published by John Wiley & Sons Ltd

## 1 | INTRODUCTION

The World Energy Council highlights in its 2019 World Energy Insights Brief that growth in electricity generation is unavoidable in the future.<sup>1</sup> Most of the scenarios investigated in the brief suggest that the overall fossil fuel contribution in the global diverse energy mix will not get lower than 70% by 2040. Also, the brief predicts a steep growth in natural gas usage. It is projected that natural gas will contribute approximately 20% of the primary energy mix by 2040.<sup>1</sup> The rising supply of tight gas and shale gas as well as the technology maturity of natural gas power generation units will all contribute significantly to the increase of natural gas usage.<sup>2,3</sup>

An advantage of energy generation via natural gas combined cycle (NGCC) is the high efficiencies and reduced emissions compared to coal-fired plants.<sup>4</sup> This also plays a role in the growing usage of natural gas in the fossil fuel energy sector as opposed to other fossil fuels. The rapidly increasing global population is going to lead to a substantial increase in energy consumption for daily use in homes and offices.<sup>5,6</sup> This will contribute to an increase in fossil fuel demand and subsequently to an increase in emissions from energy generation plants. Currently, 40% of the total CO<sub>2</sub> emissions are emitted in conventional fossil fuel power units.<sup>7</sup> Therefore, an escalation in energy demand will lead to an increase in CO<sub>2</sub> emitted and consequently stabilizing the amount of CO<sub>2</sub> in the atmosphere will require a variety of modifications to the power plant such as increase in plant efficiency and the development of technology to reduce the CO<sub>2</sub> emitted into the atmosphere.<sup>8</sup> Hence, there have been heightened interest and investments in the development of emission strategies such as the decarbonisation of electricity generation.<sup>1</sup> One means of implementing this strategy is by the use of fossil fuels with carbon capture and storage (CCS) techniques such as post-combustion capture (PCC). CCS is debated to be a technology capable of mitigating the greenhouse gas emissions from fossil fuel power plants by 50% to 85% by 2050,<sup>9</sup> hence bringing the 2° scenario target closer. The energy technology perspective (ETP)<sup>10</sup> has estimated that achieving the 2° limit would require a similar amount of reductions in emissions by 2050.

The PCC is not a new technology and has been used in other industries including the iron and steel industry<sup>11</sup> as well as the cement industry.<sup>12</sup> The implementation of CCS into the energy sector can prove to be of high advantage once the technology has fully matured from its development stage to its fully commercial stage. Research has been carried out worldwide by universities and research groups aiming to investigate different carbon capture techniques that are able to remove CO<sub>2</sub> from the

flue gases of various power generation sources. Thus, highlighting the significance of CCS technologies in the primary energy mix of the future, with the ETP 2017 report predicting 18% of the global carbon emissions reductions by 2060 will be as a result of CCS.<sup>10</sup> In the future, CCS is anticipated to be a key technology in mitigating the carbon emissions in an energy sector operated by fossil fuels.<sup>13</sup> Currently, there are some CCS technologies adapted for commercially scaled fossil fuel energy generation systems, which are the SaskPower Boundary Dam in Canada,<sup>14</sup> the Peterhead CCS project in the United Kingdom<sup>15</sup> and the PetraNova in the United States.<sup>16</sup> With the implementation of CCS with fossil fuels, there will be unlocking of more fossil fuel reserves, used in the energy sector. Hence, making the targeted global temperature increase of only 2°C by 2050 more realistic.<sup>17</sup> Also, its ability to be retrofitted with existing plants makes it a promising technology for CO<sub>2</sub> capture.<sup>8</sup> One important concern regarding the utilisation of CCS with NGCC is its operational flexibility with different fuels of varying compositions with the aim of achieving a secure delivery of electricity.<sup>18,19</sup>

Natural gas is a mixture of methane, ethane, propane, butane, pentane, as well as nitrogen and carbon dioxide.<sup>20</sup> Other components include hydrogen sulphide and helium. Natural gas compositions differ in different regions due to the different processes that lead to the formation of the fossil fuel.<sup>21</sup> Part of the components of natural gas fields that are available in large amounts is carbon dioxide.<sup>5</sup> The carbon dioxide in many natural gas fields can vary up to 20%, with the CO<sub>2</sub> in some other fields getting as high as 50%.<sup>21</sup> Natural gas with very high CO<sub>2</sub> content is usually sent for CO<sub>2</sub> removal since high CO<sub>2</sub> amounts will lead to a decrease in the specific lower heating value (LHV) of the fuel.<sup>5</sup>

In the literature, there are several studies that analyse the integration of an NGCC with an amine-based capture plant such as Adams and Mac Dowell,<sup>4</sup> in which useful insights on operating both the NGCC and the amine capture plant are provided. Some researchers, such as Øi et al,<sup>22</sup> have also investigated advanced configurations of the absorption and the desorption process in order to decrease the capital and operational cost. However, the lack of economic considerations in this study raises the issue of applicability and hence its potential to be integrated into the current energy sector.

There are several studies that look into the effect of different natural gas compositions on the operation of gas turbines and combustion performance.<sup>5,23,24</sup> Also, there have been a few investigations into the techno-economic performance of amine capture plants that were coupled to NGCCs.<sup>25-28</sup> These papers performed a comparative investigation on the effect of different NGCC configurations,

including the use of systems such as EGR and S-EGR, exhaust gas recirculation and selective exhaust gas recirculation respectively, and their varying exhaust gas composition of varying capture plant specifications.

Other researchers such as Cormos et al<sup>29</sup> investigated alternative innovative capture methods such as calcium looping to be integrated with the NGCC, and concluded that reactive gas-solid systems such as calcium looping cycles provide better techno-economic performance than other gas-liquid carbon capture options such as amine capture plants. Also, researchers such as Li et al<sup>30</sup> and Chu et al<sup>31</sup> focused on optimizing the operation of a pilot scale amine capture plant that uses MEA for various operating conditions and parameters. Li et al<sup>30</sup> concluded that the optimal operating condition in a pilot plant was obtained when operating at 35 wt% MEA, 0.25 (molCO<sub>2</sub>/molMEA) lean CO<sub>2</sub> loading, 40°C lean solvent temperature, 200 kPa stripper pressure, hence resulting in 3.6 MJ/kg CO<sub>2</sub> as the reboiler duty. Chu et al<sup>31</sup> suggested an increase in size of the porosity of the packing material as well as the surface area per unit volume to attain a minimum energy consumption.

Regarding various fuels being coupled with a capture plant, researchers such as Berstad et al<sup>32</sup> performed a parametric comparative study on a MEA-based CO<sub>2</sub> capture plant coupled with an NGCC, coal and biomass power generation units. In the study, it was concluded that the NGCC produced the lowest efficiency penalty, which is mainly due to the high efficiency in the system mentioned earlier. Also, Agbonghae et al<sup>26</sup> performed a process modelling study in which the lean CO<sub>2</sub> loading and solvent recirculation rate in a commercial-scale amine capture plant were optimized. Furthermore, a techno-economic assessment was conducted to obtain the optimum process design of the capture unit. The plant was simulated to service both coal-fired and offshore-based gas-fired power plants.


Overall, the utilization of varying fuel compositions with CCS is currently unclear. Thus, this study aims to deliver an in-depth understanding into the operational and economic benefits and drawbacks associated with fuel flexibility operations of an NGCC with CCS. The main novelty in this paper rests on the assessment of the effect of fuel flexibility on the performance of a commercial-scale NGCC integrated with CCS and a further analysis on its effect on the techno-economics of a commercially scaled amine capture plant. This study aims to fill the gap in knowledge pertaining to the implementation of an NGCC operating with various CO<sub>2</sub> content fuels and the ensuing downstream effect observed when an amine capture plant is coupled. The maximum fuel CO<sub>2</sub> concentration investigated in this study is

10 mol%, and this is to ensure the complete convergence of the combustor model in the software package used. Also, similar studies performed by Nikpey et al<sup>33</sup> on a micro gas turbine with varying increase in CO<sub>2</sub> content in the fuel highlight that combustor flameout occurs when operating at higher than 10 mol% CO<sub>2</sub> in the fuel at full load operating conditions. The CCS technique investigated in this study is PCC with monoethanolamine (MEA), which serves as the base case and it is a mature technology available for CO<sub>2</sub> capture from exhaust flue gases. From the literature, the optimal amount of solvent is 30 wt% MEA, and this value is used in this analysis.<sup>34,35</sup> In this context, this value is considered the benchmark for much of the research and development in CO<sub>2</sub> capture studies.<sup>36</sup> The developed NGCC model uses as basis a 2013 report of the United States Department of Energy<sup>37</sup>; the report provides detailed information on the parameters and performance of the plant that can foster simulations. The capture plant was modelled and modified off literature and the hydrodynamic parameters mentioned earlier.


## 2 | PROCESS DESCRIPTION

In this paper, an NGCC plant of 650 MWe is simulated; the size is identical to that reported in the 2013 US Department of Energy (DOE)/NETL report.<sup>37</sup> The model is based on an offsite NGCC power plant located in Greenfield, Midwestern USA. The site is located on a 300 acre of land, which is land locked, hence only access being by rail and the highway.<sup>38</sup> Herein, we evaluate the effect of operating the NGCC with varying natural gas compositions with the focus on the CO<sub>2</sub> content in the fuel. The downstream effect of the varying fuel composition is also investigated as the exhaust flue gas exits the heat recovery steam generators (HRSG) with different compositions and different temperatures and flowrates which affect the mechanical energy generated in the steam turbines. The fundamental flowsheet of the NGCC is depicted in Figure 1.

The present study extends from the baseline NGCC to investigate the incorporation of the NGCC and a CO<sub>2</sub> capture unit when the NGCC is operating with a range of fuel compositions. When a CO<sub>2</sub> capture unit is coupled within the cycle, the thermal energy of the heat recovery system will be affected as some steam is withdrawn from the steam cycle for the heat demand of the capture plant.<sup>39</sup> The basic flowsheet of a CO<sub>2</sub> capture plant using amines is shown in Figure 2. The flowsheet is comprised of two main columns, namely the absorber and the stripper columns, as well as a cross heat exchanger, coolers, pumps, reboiler and condenser. The process comprises a

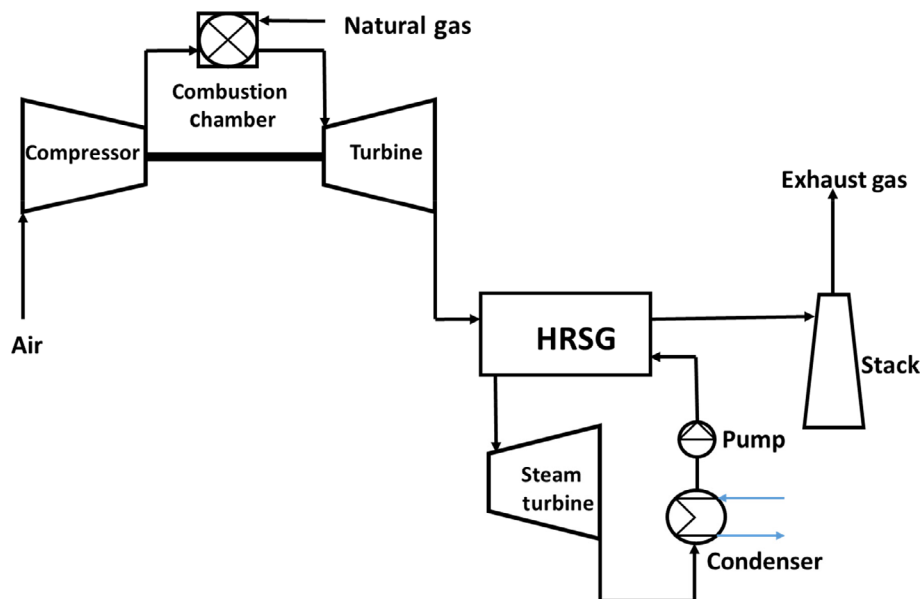

**FIGURE 1** Process schematic of a natural gas combined cycle (NGCC) power plant [Colour figure can be viewed at [wileyonlinelibrary.com](http://wileyonlinelibrary.com)]

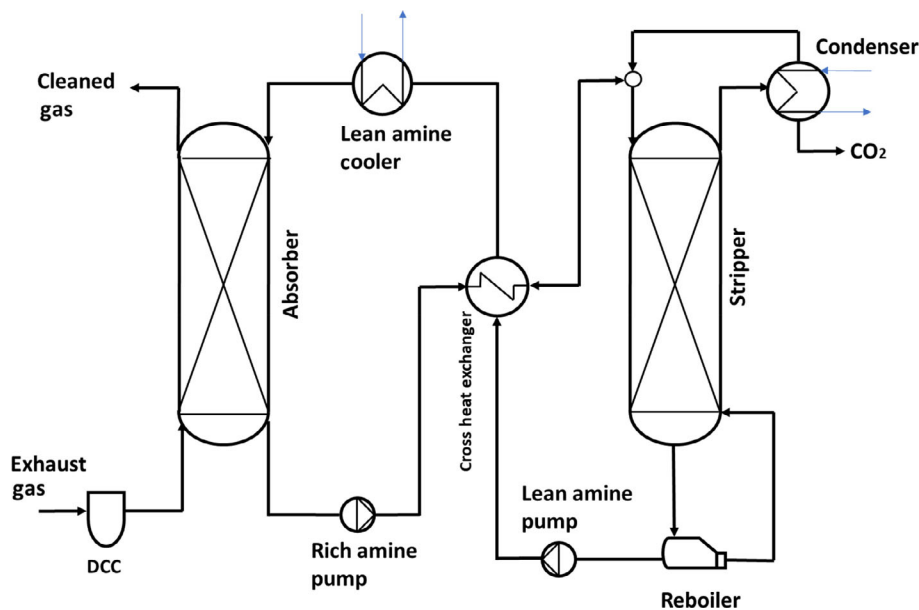

**FIGURE 2** Process schematic of the CO<sub>2</sub> capture plant [Colour figure can be viewed at [wileyonlinelibrary.com](http://wileyonlinelibrary.com)]

stream of exhaust flue gas passing through a direct contact cooler (DCC) that goes into the bottom of the packed absorber column, where it comes into contact with a counter current flow of lean amine solvent that enters the top of the absorption column. Thus, the treated gas produced, containing low amounts of CO<sub>2</sub>, leaves the absorber at the top of the column and will often pass through a water wash column (not shown in Figure 2) to get rid of any entrained amines in the treated gas. The MEA solvent flow exiting the bottom of the absorber column is pre-heated by the cross heat exchanger and, with the use of pumps, the rich solvent flows to the top of the stripper column. This helps reduce the regeneration heat demand for the solvent.<sup>38</sup>

In the stripper (desorber), the solvent rich in CO<sub>2</sub> flows downwards and is heated by the steam raised in the reboiler, thus leading to the desorption of the CO<sub>2</sub> contained in the rich solvent. This leads to the regeneration of the lean amine solvent. The vapour stream leaving the stripper containing high amounts of CO<sub>2</sub>, steam and small entrained droplets of MEA is partially condensed in a condenser. The uncondensed CO<sub>2</sub> is sent through the processes of drying and compression before being forwarded for CO<sub>2</sub> storage, while the other components are condensed and refluxed to the top of the stripper.<sup>25</sup>

By increasing the CO<sub>2</sub> content in the fuel, the LHV of the fuel and the combustion temperature in the combustion chamber will reduce. The reduction of the LHV will cause

the operating point of the gas turbine to move towards its stability limit.<sup>40</sup> To maintain the same power input in the system, the fuel flowrate increases as the CO<sub>2</sub> concentration in the fuel also increases. The specific heat of the flue gas is also expected to increase because of the rise in the CO<sub>2</sub> content in the flue gas, which subsequently further reduces the flue gas temperatures. Downstream, the higher flue gas flowrates impacts the CO<sub>2</sub> capture plant, which reduces the residence time in the column and may negatively impact on the mass transfer to the solvent, however higher CO<sub>2</sub> concentrations entering the absorber column will improve mass transfer rates and may negate this impact. The growth in CO<sub>2</sub> concentration within the flue gas would also increase the required capture rate to match the same absolute flowrate of emissions leaving in the clean gas, which may also require the capture plant to operate beyond the 90% capture rate and this is often referred to as the optimum capture specification in the open literature.<sup>26</sup>

### 3 | METHODOLOGY

Using process modelling, the systems and parameters in this paper were investigated. The modelling approach is analysed as well as the input parameters which need to be specified to determine the required output.

#### 3.1 | Modelling approach

The NGCC and CO<sub>2</sub> capture plant were modelled using gCCS v1.1.0, a process modelling software package developed by PSE specifically for energy and CO<sub>2</sub> capture systems.<sup>41</sup> The commercial-scale NGCC power plant design comprises of two state-of-the-art commercial GE 7FA.05 gas turbines, two triple pressure level single reheat type HRSG and a condensing steam turbine with an evaporative cooling tower.<sup>37</sup> The HRSG configuration includes high-pressure (HP), intermediate-pressure (IP) and low-pressure (LP) steam drums as well as superheaters, reheaters and economisers. In addition, the steam turbine section includes HP, IP and LP steam turbines with isentropic efficiencies of 88.3%, 92.4% and 90.7%, respectively, and the condenser operating at 5000 Pa.

The compressed air and natural gas are combined in a combustor which is manufactured to produce low NO<sub>x</sub> emissions at high temperatures. In the turbine, expansion occurs, and the flue gas produced exits the turbine at approximately 604°C (for the 2013 DOE/NETL analysis).<sup>37</sup> There is an assumed pressure drop of 5% being simulated across the combustor.<sup>27</sup>

The gas turbine section has two main parts, namely the compressor section and the turbine section. In the

compressor, the pressure ratio and the isentropic efficiencies are specified and the isentropic efficiency and the outlet pressure are the parameters specified for the gas turbine. The pressure ratio is obtained from the 2013 DOE/NETL report<sup>37</sup> and the isentropic efficiency is calculated using the provided parameters at nominal operation. A similar procedure is used to calculate the isentropic efficiency for the turbine, while the outlet pressure is provided in the same 2013 DOE/NETL report<sup>37</sup> used for the compressor analysis.

The HRSG is initially configured in a calibration mode at which the outlet pressures, temperatures and the heat transfer coefficients are specified in accordance to the 2013 DOE/NETL report.<sup>37</sup> These inputs are used to estimate the heat transfer area of each component. The areas are then specified with the system which is then re-configured in an operational mode. The three steam turbines were modelled using a similar methodology as the heat transfer components in the HRSG. The turbines were configured based on the 2013 DOE/NETL report by specifying inlet and outlet states of the turbine at nominal conditions.<sup>37</sup> These inputs are used to calculate the isentropic efficiency and Stodola's constant.

The Stodola's constant and isentropic efficiency are implemented to allow the monitoring of off-design conditions of the steam turbines.<sup>42</sup> This is because the model has to account for different non-linear behaviours of efficiency, pressure ratios and rotational speeds between steam drums at different operating conditions of steam as mentioned by Dettori et al.<sup>43</sup> Therefore, to estimate the steam turbines real behaviour when mass flow and pressure change, the Stodola's Ellipse equation<sup>42,43</sup> is applied.

The fuel and air properties as shown in Appendix A highlight the input conditions for the NGCC. These properties are similar to the NGCC conditions reported in the 2013 DOE/NETL report,<sup>37</sup> so as to ensure an unbiased comparison in base case results for validation purposes. The combustion turbine section of the NGCC is modelled with a fixed power output of the system which was set to produce the same power output as the 2013 DOE/NETL report (420.8 MW).<sup>37</sup> In the fuel flexibility modelling, the operating fuel is changed from a natural gas composition considered as the base case fuel, as shown in Appendix A, to other high CO<sub>2</sub> content fuels. Other inputs such as the air composition are kept constant to examine the impact of the varying fuel compositions on the overall performance of the system.

The fuel composition is changed with the addition of CO<sub>2</sub> to the fuel. This is employed to investigate the effect of the change in fuel composition on the operation of the NGCC system, focusing on the HRSG and steam turbine performance. With the addition of CO<sub>2</sub> to the fuel, the LHV reduces. In order to accommodate the specified

power output in the system, the combustor requires more fuel; therefore, the flowrate of the fuel into the combustor increases. Although there is no change to the air composition entering the compressor, the combustion of the fuel and air changes with increase in the CO<sub>2</sub> content in the fuel. This changes the efficiency of the turbine and the compressor and furthermore affects the overall efficiency of the system, however, the change in combustion efficiency is not considered in this study.

### 3.2 | Carbon dioxide capture plant

The CO<sub>2</sub> capture plant uses the electrolyte NRTL thermodynamic property package for the liquid phase properties and gSAFT equation of state for the vapour phase properties.<sup>26,41</sup> The exhaust gas from the NGCC goes into a DCC/heat exchanger that reduces the temperature of the exhaust flue gas in order to improve the efficiency of the capture plant. At the entrance of the absorber, the temperature of the exhaust gas is controlled at 40°C.<sup>25,27,28</sup> The pumps in the system are specified to operate at an efficiency of 75%, with the rich and lean amine pump generating a maximum pressure of 3 bar for the base case with natural gas.<sup>26,27</sup> The CO<sub>2</sub> capture plant is configured to achieve a capture efficiency of 90% at its base case scenario, while utilising a solvent concentration of 30 wt% MEA and 70% water. The loading of the lean solvent was set to 0.2 mol CO<sub>2</sub>/mol MEA.<sup>44</sup> The regeneration temperature in the reboiler is set to 120°C, at values higher solvent degradation often occurs,<sup>39</sup> and the pressure in the reboiler is set to a value of 1.8 bara.<sup>25,28</sup> To supply some of the necessary hot steam to the reboiler, a fraction of the steam entering the LP turbine is extracted after leaving the IP steam turbine section. The steam is redirected to the reboiler, which is used to supplement the solvent regeneration process. The saturated steam exiting the reboiler is sent back into the steam cycle via the condenser.<sup>28</sup> The steam draw off from the IP/LP turbine crossover was also recommended from literature.<sup>45</sup> As a result of the reduced steam flow with the LP turbine, the power generated by the steam turbines is reduced. This in turn affects the overall steam turbine power and efficiency when CO<sub>2</sub> capture is retrofitted into the system.

In designing the columns for the CO<sub>2</sub> capture plant, the optimum geometry, that is, diameter and height, of the absorber and stripper columns had to be determined based on the hydrodynamic parameters, the capture rate and specific reboiler duty at a chosen packing type and solvent concentration.<sup>26</sup> The packing type used in this process model is the structured packing Mellapak 250 Y, characterised by its specific surface area of 250 m<sup>2</sup>/m<sup>3</sup> and a 45° angle of orientation to the vertical axis.<sup>46,47</sup> This

packing type was chosen because of its high efficiency and low pressure drop. The mass transfer coefficients used to calculate the hydrodynamic parameters were estimated using the Billet and Schultes<sup>48</sup> correlation.

For an optimum design of the system, we use two and one absorber and stripper columns, respectively. This design is based on the column cost and the heat requirement associated with the capture system.<sup>38</sup> Hence, the minimum number of columns is chosen with the aim of obtaining a balance between a higher capital and operating cost and a reduced heat requirement in the system.

Using two absorber columns also provide greater operational flexibility when operating with flexible fuel scenarios.<sup>28</sup> In addition, Lawal et al.<sup>38</sup> suggested that employing more than one absorber column could enhance the turndown ratio in processing large volumes of flue gas from the power plant.

The operating region of the packed columns is determined by its hydrodynamic parameters, the maximum pressure drop tolerated in the column and the maximum flooding velocity of the column.<sup>25,26</sup> At the flooding point, the pressure drop due to the gas flow increases to an extent at which the solvent cannot flow downwards in a counter-current manner against the gas flow.<sup>38</sup> At this point, the area of the packing surfaces that are wetted is reduced and thus affecting the operation of the columns.<sup>38</sup> At higher flue gas flowrates entering the absorber, the columns become more liable to reaching the flooding point and becoming inoperable.

The absorber column diameter is designed to operate at 80% of the flooding point for the base case scenario.<sup>25,27,28</sup> The absorber height was determined by adjusting the packing height manually until 90% CO<sub>2</sub> capture efficiency is achieved in the absorber column. With increase in packing height, there is increase in mass transfer area which improves the absorption of CO<sub>2</sub>. With columns that are higher than 18 m, the increase in efficiency of the plant is negligible and hence considered insignificant in this analysis. Also, the high cost incurred with longer absorbers was not considered feasible in this study.<sup>8</sup> A similar criterion is employed to calculate the stripper column diameter, whilst the specific reboiler duty in the system is reduced to increase the stripper height. This was done in order to determine the extent to which there was a negligible reduction of less than 1% of the specific reboiler duty while increasing the stripper height. The packing height of the absorber column was 17.10 m and for the stripper column it was 30.27 m. While the columns diameter for the absorber column was 16.32 m and for the stripper column, it was 8.90 m.

The design of the CO<sub>2</sub> capture system uses as basis the technical specifications presented in Appendix B. Some parameters in the system are kept constant while the

changes in the rest due to the changes in fuel composition have been reported. The parameters kept constant were the solvent lean loading, the CO<sub>2</sub> concentration of the treated gas exiting at the top of the absorber, the cross heat exchanger pressure drop and heat transfer area, the pump efficiencies and the reboiler pressure and temperature.

The mass flowrate of emitted CO<sub>2</sub> exiting the top of the absorber is kept constant while varying CO<sub>2</sub> concentrations in the fuel. This results in the required CO<sub>2</sub> capture rate increasing across the cases; however, it allows for consistent analysis, whereby the plants are expected to produce a treated gas with low CO<sub>2</sub> emissions. The constant CO<sub>2</sub> concentration leaving the top of the absorber ensures there is no increase in emissions in the different cases, highlighting the impact of the study on the mitigation of greenhouse gas emissions.

## 4 | RESULTS AND DISCUSSION

### 4.1 | Base case analysis

The base case simulation results obtained for the analysis in this study are summarised in Table 1. The results are shown to be in close accordance with the published values in the 2013 DOE/NETL report.<sup>37</sup> The auxiliary power for the pumps and other systems are determined by the gCCS software. The data shown in Table 1 highlight the comparison of the data derived from the standalone NGCC power plant and the effect of coupling the NGCC to the CO<sub>2</sub> capture unit. The model was built in a similar way to the DOE report to ensure unbiased comparison in data. Modelling of the CO<sub>2</sub> capture system was carried out according to the flue gas obtained from the NGCC operating with the base case fuel composition. This was to ensure the capture plant was sized to operate at optimum performance.

The results show that the steam turbine power reduces when the CO<sub>2</sub> capture plant is introduced. This is due to the CO<sub>2</sub> capture plant that extracts some steam from the IP/LP crossover from the steam turbine section, causing a decrease in the thermal energy in the steam turbine sections. As the steam turbine power reduces the total gross power output reduces. Regarding the auxiliary power in the system, there is an observed increase in this value. An integrated CO<sub>2</sub> capture plant means there is more energy requirement in the overall system, such as the CO<sub>2</sub> plant auxiliary pumps and the CO<sub>2</sub> compression turbine. This increase in auxiliary power causes a reduction in the net power plant output and reduces the net power plant efficiency.

Comparing the results obtained in the model to the 2013 DOE/NETL report,<sup>37</sup> there is strong agreement. The values reported here are all within a 5.1% of the reference report. The major deviations occurred in the NGCC

**TABLE 1** Inputs and base case results for the standalone natural gas combined cycle (NGCC) and with CO<sub>2</sub> capture

Standalone NGCC	2013 DOE/NETL <sup>37</sup>	gCCS model
Input		
Natural gas flowrate (kg/s)	23.38	23.38
Gas turbine power (MWe)	420.82	420.82
Output		
Air flowrate (kg/s)	1006.34	1006.32
Steam turbine power (MWe)	229.61	229.59
Total gross power output (MWe)	650.42	650.41
Power plant auxiliaries (MWe)	16.53	15.81
Total net power output (MWe)	633.89	634.60
Net power plant efficiency (%)	57.4	57.51
NGCC with CO <sub>2</sub> capture plant	2013 DOE/NETL <sup>37</sup>	gCCS model
Steam turbine power (MWe)	185.50	176.06
Total gross power output (MWe)	606.32	596.88
Power plant auxiliaries (MWe)	53.5	49.95
Total net power output (MWe)	552.82	546.92
Net power plant efficiency (%)	50.1	49.56

coupled with CO<sub>2</sub> capture case. This can be attributed to the fact that the dimensions for the CO<sub>2</sub> capture plant used in this study are not similar to the 2013 DOE/NETL report and other publications using a similar NGCC process schematic, although employing similar parameters to obtain its dimensions. The sizing of the columns were higher to account for the increase in mass transfer and packing area in the columns which is necessary to operate with higher amounts of CO<sub>2</sub> in the flue gas with an acceptable CO<sub>2</sub> capture performance such as a low reboiler duty and capture rate of around 90%. This leads to an increase in steam drawn off from the steam turbines since higher amounts of thermal energy are required for solvent regeneration. Thus, the model having a lower steam turbine power output compared to the 2013 DOE/NETL report.<sup>37</sup>

### 4.2 | Fuel flexibility analysis

The effect of varying the CO<sub>2</sub> concentrations in the fuel is extensively examined with the modelling of the increased CO<sub>2</sub> content in the fuel. The concentrations being

examined are 5%, 7.5% and 10% CO<sub>2</sub> in the fuel. The compositions of the fuels used in the analysis are shown in Table 2. The four fuel compositions are derived from the base case natural gas composition used in the 2013 DOE/NETL report.<sup>37</sup> The compositions of the others fuels are derived from adding CO<sub>2</sub> into the base case natural gas. This was repeated for all the examined CO<sub>2</sub> concentrations (5%, 7.5% and 10%). Since the CO<sub>2</sub> concentration increases, the concentrations of the hydrocarbons and the nitrogen reduce.

The results obtained from the modelling of the varying fuel compositions in the NGCC with CO<sub>2</sub> capture is depicted in Table 3. The major process variables investigated are the steam turbine power output, auxiliary power, power plant output, turbine inlet temperature (TIT), CO<sub>2</sub> capture efficiency, turbine outlet temperature (TOT), the reboiler duty and the flooding ratio in the columns.

**TABLE 2** Fuel compositions for the different fuels used in the fuel flexibility analysis

	Natural gas	5% CO <sub>2</sub>	7.5% CO <sub>2</sub>	10% CO <sub>2</sub>
Methane (mol%)	93.1	89.3	86.9	84.6
Ethane (mol%)	3.2	3.1	3	2.9
Propane (mol%)	0.7	0.7	0.7	0.6
Butane (mol%)	0.4	0.4	0.4	0.4
Nitrogen (mol%)	1.6	1.5	1.5	1.5
Carbon dioxide (mol%)	1	5	7.5	10
Lower heating value (MJ/kg)	47.20	42.60	40.00	37.60

As shown in Table 3, with the CO<sub>2</sub> concentration in the fuel increasing, the LHV of the fuel decreases. This leads to an increase in the fuel flowrate entering the system. Hence, the overall combination of fuel and air into the gas turbine increases and also an increase in the flue gas flowrate exiting the system.

When operating with higher CO<sub>2</sub> content fuels, the temperatures across the turbine are seen to reduce, specifically the TIT and the TOT. This is because the air-fuel ratio is seen to reduce as the mass flowrate of the air is constant whilst the flowrate of the fuel increases due to the reduction of the LHV. This would lead to an increase demand in excess air, however, in the model, the excess air is not observed to increase, hence causing reduction in the combustion outlet temperature which is the TIT. In addition to the TIT reducing, the TOT also reduces as a result of a lower temperature combustion gas being used for turbine expansion.

By introducing the CO<sub>2</sub> capture unit, the power produced in the steam turbine reduces due to some energy generated being utilised to regenerate the amine solvent in the capture plant. With the introduction of CO<sub>2</sub> in the fuel, the steam turbine power reduces even further. As shown in Table 3, the flue gas temperature exiting the HRSG reduces with increase in CO<sub>2</sub> content in the fuel. This is because the introduction of CO<sub>2</sub> reduces the LHV of the fuel and with its increase in concentration, the combustion temperature reduces, and hence reduces both TIT, TOT and steam turbine power output.

The three pressure sections in the steam turbine area are the HP, IP and LP sections. As explained earlier in

Parameters	Natural gas	5% CO <sub>2</sub>	7.5% CO <sub>2</sub>	10% CO <sub>2</sub>
Fuel flowrate (kg/s)	23.38	25.88	27.55	29.32
Gas turbine power output (MWe)	420.82	420.82	420.82	420.82
Steam turbine power output (MWe)	176.06	174.43	173.45	172.49
Total gross power output (MWe)	596.88	595.25	594.27	593.30
Auxiliary power (MWe)	49.95	50.45	50.73	50.99
Total net power plant output (MWe)	546.92	544.80	543.54	542.32
Net power plant efficiency [LHV] (%)	49.56	49.42	49.32	49.20
Turbine inlet temperature (°C)	1271	1268	1267	1265
Turbine outlet temperature (°C)	606.63	605.37	604.53	603.65
Flue gas temperature (°C)	93.19	87.76	84.56	84.51
CO <sub>2</sub> capture rate (%)	90	90.4	90.6	90.8
O <sub>2</sub> concentration in flue gas (mol%)	12.37	12.36	12.33	12.3
CO <sub>2</sub> concentration in flue gas (mol%)	3.91	4.06	4.15	4.26
Flue gas flowrate (kg/s)	1029.7	1032.2	1033.89	1035.66
Solvent rich loading (mol CO <sub>2</sub> /mol MEA)	0.471	0.472	0.473	0.474

**TABLE 3** Results with the use of various fuel compositions in the natural gas combined cycle (NGCC) with CO<sub>2</sub> capture

the modelling methodology, the parameters used to configure the steam turbine sections are the isentropic efficiency and the stodola's constant. These parameters access the operational flexibility of each section of the steam turbine as the outlet temperatures, mass flow and pressures vary according to the input of the system.

The results in Table 3 show that the increase of the CO<sub>2</sub> content in the fuel cause a reduction in the power generated in the steam turbine. Increasing the CO<sub>2</sub> concentration and flowrate of the flue gas entering the HRSG, there is an observed increase in thermal input into the steam turbines. With increase in CO<sub>2</sub> concentration at absorber inlet, more steam is extracted from the IP/LP crossover to the reboiler for desorption. This is due to the higher solvent flowrate and the increase in required CO<sub>2</sub> capture rate despite the increase in CO<sub>2</sub> partial pressures. Thus, the thermal duty required by the capture plant increases which increases the thermal consumption from the steam turbines. This causes the LP section of the steam turbine section to have less steam energy being sent to the generators, hence reducing the steam turbine power output.

### 4.3 | CO<sub>2</sub> capture plant analysis


The liquid/gas (L/G) ratio also has an important effect on the performance of the CO<sub>2</sub> capture unit. As exposed in Figure 3, the L/G ratio increases with the increase in the fuel CO<sub>2</sub> concentration. The L/G ratio increases due to increase in the flowrate of the flue gas into the absorber, hence leading to a proportionally higher solvent flowrate being required for absorption. At higher flue gas flowrates and higher CO<sub>2</sub> concentrations in the flue gas, with a constant lean loading, the CO<sub>2</sub> capture rate increases in the column which implies that the CO<sub>2</sub>

concentration in the rich loading leaving the absorber will also increase.

The reboiler duty also plays an important role in the techno-economic performance of NGCC power plants with CO<sub>2</sub> capture.<sup>49</sup> The relationship between the L/G ratio and the specific reboiler duty in the CO<sub>2</sub> capture system is depicted in Figure 3. At a low L/G ratio, the specific reboiler duty is high. This observation is validated by models developed by Cifre et al<sup>8</sup> and experiments performed by Akram et al.<sup>50</sup> At a higher L/G ratio, the solvent flowrate is increased to capture the required CO<sub>2</sub> from the flue gas. However, the energy required for regeneration per kg of CO<sub>2</sub> decreases because there is more CO<sub>2</sub> in the rich solvent and the CO<sub>2</sub> is being stripped more efficiently. The increase in the L/G ratio leads to an increase in the flooding velocity in the column. Although it is desirable and practical to operate the columns as close to flooding as possible so as to enhance the interfacial mass transfer characteristics in the column,<sup>51</sup> however, increasing the L/G ratio in the system also relates to the column approaching the flooding point. This causes the operation of the CO<sub>2</sub> capture plant to go beyond the optimal operation for CO<sub>2</sub> absorption. Beyond this point, there is an observed rapid increase in pressure drop in the column, liquid carryover from the top of the column and instability in the column.<sup>46</sup>

### 4.4 | Techno-economic assessment

The basic techno-economic assumptions are summarised in Table 4. The location of the plant is US Gulf coast, the reference year of the study is 2018 and the currency is USD. The capital expenditure of the NGCC and CO<sub>2</sub> capture plant, as well as the operating cost for the different fuels, was estimated based on simulation results and

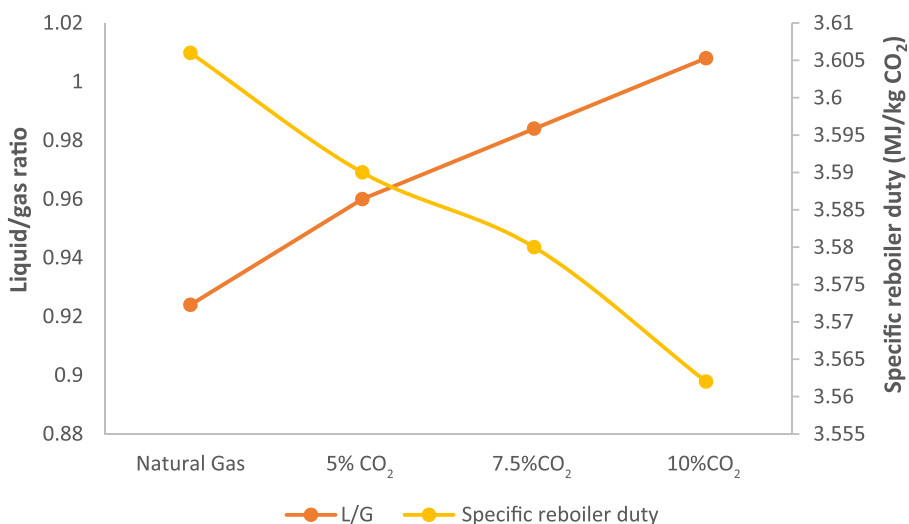

**FIGURE 3** Graphical representation of the relationship between the liquid/gas (L/G) ratio and the specific reboiler duty [Colour figure can be viewed at wileyonlinelibrary.com]

**TABLE 4** Economic assumptions employed<sup>37</sup>

Parameter	Value	Unit
Capacity factor	85	%
Capital charge factor with CCS	11.1	%
Total as spent cost factor	107.8	%
CO <sub>2</sub> transport and storage cost over 100 km	10	\$/tonne CO <sub>2</sub>
Plant operational period	30	Years
Cost year	2018	-

vendor quotes. The present work utilises the capital cost scaling technique, as presented in the NETL study of NGCC systems,<sup>52</sup> to calculate equipment costs. Generally, the characteristic parameter used in the comparison of different power plants is the cost of electricity (COE). Moreover, on taking into consideration the retrofit of the power plants with CCS, the evaluation in this study includes the estimation of carbon management cost with the cost of CO<sub>2</sub> avoided (COA). The COE is determined by<sup>37</sup>:

$$\text{COE} = \frac{(\text{CCF})(\text{TOC}) + \text{OC}_{\text{FIX}} + (\text{OC}_{\text{VAR}}) + \text{FC}}{(\text{CF})(\text{MWh})} \quad (1)$$

where CCF is the capital charge factor, TOC is the total overnight cost, OC<sub>FIX</sub> is the sum of fixed annual operating costs, CF is the capacity factor, OC<sub>VAR</sub> is the sum of variable annual operating cost, FC is the fuel cost for one operating year and MWh is the annual net megawatt-hours of power generated at 100% capacity.

The cost of CO<sub>2</sub> avoided is determined by<sup>37</sup>:

$$\text{COA} = \frac{(\text{COE}_{\text{CCS}} - \text{COE}_{\text{ref}})}{(\text{Emission}_{\text{ref}} - \text{Emissions}_{\text{CCS}})} \quad (2)$$

Where COE<sub>CCS</sub> and COE<sub>ref</sub> are the COE with and without CO<sub>2</sub> capture, respectively. Emission<sub>ref</sub> and Emission<sub>CCS</sub> are the CO<sub>2</sub> emission rate with and without CO<sub>2</sub> capture, respectively.

#### 4.4.1 | Capital cost

The main parameter in calculating the COE is the TOC, which is calculated from the total plant cost (TPC). Estimation of the capital cost for each major component is derived from the 2013 DOE/NETL report<sup>37</sup> as the reference case. The equipment costs are estimated based on simulation results and then scaled using Equation (3)<sup>27,28,52</sup> in a similar approach as the initial NETL study of the

NGCC. This is to provide an unbiased comparative analysis on the operation of the NGCC.

$$\text{SC} = \text{RC} \left[ \frac{\text{SP}}{\text{RP}} \right]^n \quad (3)$$

where SP is the scaling parameter, RP is the reference parameter, RC is the reference cost, SC is the scaled cost and  $n$  is the scaling exponent. In addition, all costs are adjusted to 2018 USD by utilising the Chemical Engineering Plant Cost Indices. Table 5 tabulates the data required for equipment cost estimation.

The scaling cost of the different plant components are based on the operational data obtained in the plant modelled in gCCS and compared to the reference case in the 2013 DOE report.<sup>37</sup> The scaled costs are then added up to obtain the TPC, which is the overall cost of the plant. The TOC of the plant is the calculated from the TPC and other costs which are considered in the construction of the plant. The other costs and their basis of estimation are tabulated in the Appendix C. The operating expenditures of the plant are discussed in Section 4.3.2, where the basis used to estimate the fixed and variable operating costs is highlighted.

#### 4.4.2 | Operating cost

As shown in Equations (1) and (2), the COE is calculated from the TOC, OC<sub>FIX</sub> and OC<sub>VAR</sub>, and the COA is calculated from the COE. In calculating the OC<sub>FIX</sub> and OC<sub>VAR</sub>, there are other costs to be considered which are tabulated in Table 6. The estimation method is further explained elsewhere.<sup>53</sup> Using the estimation method highlighted in Table 6, the O and M cost were calculated for the varying CO<sub>2</sub> concentrations in the fuel.

#### 4.4.3 | Costing results

The TPC was assumed to be constant for all scenarios with increasing the CO<sub>2</sub> fuel content. This is because the changes in fuel compositions are expected to have a negligible effect on the cost of construction of the plant (both the NGCC and the capture plant). The results shown in Table 7 highlight the TPC difference between the model developed in gCCS and the reference case in the 2013 DOE/NETL report. The primary difference in the TPC is mainly due the use of a different CO<sub>2</sub> capture plant in the gCCS model,<sup>28</sup> compared to the 2013 DOE/NETL report. It is observed that the main variations that occur are in the cooling systems connecting the steam turbine to the capture plant. As previously stated, the key assumption in

**TABLE 5** Scaling parameters used in the estimation of capital costs in this work<sup>52</sup>

Plant component	Scaling parameter	Reference cost (\$1000)	Scaling exponent
Feed water system and miscellaneous	Feed water flowrate (HP only)	55 815	0.72
CO <sub>2</sub> removal	CO <sub>2</sub> flowrate at absorber inlet	276 219	0.61
CO <sub>2</sub> compression	CO <sub>2</sub> flowrate	36 887	0.77
HRSG, ducting and stack	HRSG duty	55 503	0.7
Steam turbine system	Steam turbine power	66 914	0.8
Cooling water system	Cooling tower duty	26 192	0.71
Instrumentation and control	Net auxiliary power	19 460	0.6
Improvements to site	Gross total	12 025	0.47
Accessory electric plant	Net auxiliary power	62 528	0.6
Buildings and structures	Gross total	13 117	0.34

**TABLE 6** Estimation method for O & M and labour costs<sup>53</sup>

Operating and maintenance cost (O & M)	
Cost	Estimate basis
Variable operating cost (OC <sub>VAR</sub> )	Maintenance material cost (1.3% TPC CF)
	Non-fuel consumables (1.5 maintenance material cost – 1.3% TPC CF)
Fixed operating cost (OC <sub>FIX</sub> )	Property taxes and Insurance (0.02 TPC)
	Operating labour rate (\$347 772/y)
	Operating labour burden (0.3 operating labour rate)
	Operators per shift (6.3)
	Number of shifts (4)
	Annual operating labour cost (operating labour rate x operating labour burden x operators per shift x number of shifts)
	Maintenance labour cost (2/3 maintenance labour cost)
	Admin and support labour (0.25 sum of other labour cost)
Fuel cost (FC)	5.81 \$/GJ HHV

**TABLE 7** Results of the costing analysis (×\$1000)

	Ref case (no CO <sub>2</sub> ) <sup>37</sup>	Natural gas (no CO <sub>2</sub> )	5% CO <sub>2</sub>	7.5% CO <sub>2</sub>	10% CO <sub>2</sub>
Total plant cost (\$)	758 709	751 765	751 765	751 765	751 765
Other costs (\$)	166 763	165 274	165 274	165 274	165 274
Total overnight cost (\$)	925 472	917 039	917 039	917 039	917 039
Operation and maintenance cost (\$/y)	229 115	228 846	228 846	228 846	228 846
CO <sub>2</sub> transport and storage (\$/MWh)	3.65	3.65	3.82	3.93	4.05
COE (\$/MWh) [with CO <sub>2</sub> T&S]	84.27	83.98	84.15	84.26	84.37
COA (\$/tonne CO <sub>2</sub> )	86.59	85.85	82.63	80.62	78.60

this work is the constant plant size used in this analysis and thereby the TPC is kept constant for all varying CO<sub>2</sub> concentrations in the fuel. The total overnight cost is also

seen to be constant for increasing CO<sub>2</sub> concentration in the fuel. This is mainly due to constant TPC which is used as an estimate basis for majority of the cost components

considered in the total preproduction cost, working and inventory capital, land, as well as initial cost for catalysts and financing costs as shown in the Appendix C.

As depicted in Table 7, higher CO<sub>2</sub> concentrations fuel increases the COE and reduces the COA. The COE increases mostly due to the increase in the CO<sub>2</sub> transport and storage cost due to the higher CO<sub>2</sub> flowrate being sent for compression and storage. While the COA, which is costed per unit of CO<sub>2</sub> captured, as the partial pressures of CO<sub>2</sub> within the flue gas increases, the capture plant's efficiency per unit of CO<sub>2</sub> increases and it becomes cheaper to avoid the emissions.

The use of fuels with high CO<sub>2</sub> content will incur higher COE prices; however, this is marginally offset by the increase in the capture efficiency of the CO<sub>2</sub> capture plant, which makes CCS more applicable when fuel flexibility is desirable. However, due to the observed approach of the amine solvent to flooding point in the columns, CO<sub>2</sub> concentrations in the fuel higher than 10% will result in the capture plant failing. To counter this, when operating with CO<sub>2</sub> content fuels higher than 10 mol%, a taller absorber and stripper column will be necessary to increase the residence time in the columns and also ensure that the appropriate capture efficiency is achieved.

## 5 | CONCLUSIONS

The present study has performed a fuel flexibility analysis on a NGCC integrated with CCS. The fuel compositions investigated involved the use of natural gas with increasing CO<sub>2</sub> concentrations. The results from this study highlight the impact of operating natural gas as a fuel with increasing CO<sub>2</sub> content in a NGCC with CCS on the associated capital and operating costs with such an operational flexibility. The NGCC without the capture plant produced a gross power output of 650 MW and with the capture plant this reduced by 8.3% to 597 MW. When operating with higher CO<sub>2</sub> content fuels, the power output reduces because of the increase in steam extraction from the IP/LP crossover to the reboiler for amine regeneration. Other parameters affected are the temperatures across the system (TIT and TOT) which are seen to reduce. This is due to the air-fuel ratio reducing, causing the combustion temperature to decrease.

The model calculates that the COE with T&S for the natural gas scenario is 83.98 \$/MWh, which increases up to 84.37 \$/MWh for the 10% CO<sub>2</sub> concentration in the fuel. While the COA reduces from 85.85 \$/tonne CO<sub>2</sub> in the natural gas scenario to 78.6 \$/tonne CO<sub>2</sub> for the 10% CO<sub>2</sub> concentration in the fuel, it was also revealed that operating with higher CO<sub>2</sub> content fuels the velocities in the absorber and the stripper increase towards the

flooding point, at which point the plant will be inoperable. To avoid this, a taller absorber and stripper column will be necessary.

The results from this study show that a NGCC power plant with CCS can be easily operated with fuels with lower LHV in scenarios where cheaper fuels are needed for combustion. This will have no effect on the TPC and the operation and maintenance cost, but will increase the T&S for the CO<sub>2</sub> by 4.7%, 7.7% and 10.8% for the 5%, 7.5% and 10% CO<sub>2</sub> concentrations in the fuel, respectively. Also, the cost of the CO<sub>2</sub> avoided will decrease by 3.7%, 6.1% and 8.4% for the 5%, 7.5% and 10% CO<sub>2</sub> concentrations in the fuel, respectively. The reduction in COA indicates the lower efficiency losses in the CO<sub>2</sub> capture system, because of the rise in the CO<sub>2</sub> concentration in the flue gas, outweighing the negative effect of the cost increase in the transport and storage of the CO<sub>2</sub>. This highlights an important trade-off in operating the NGCC with different fuel compositions. Furthermore, whilst some mild variations in the CO<sub>2</sub> content in the fuel can be easily tolerated, and are somewhat beneficial in the operation of the capture plant, it should be noted that above a limit of 10 mol% of CO<sub>2</sub> in the fuel, design modifications will have to be implemented to the capture plant. This is to ensure an efficient operation of the system.

## ACKNOWLEDGEMENT

The authors would like to acknowledge the Energy 2050 group at the University of Sheffield and the UKCCSRC (UK Carbon Capture and Storage Research Centre).

## ORCID

Stavros Michailos  <https://orcid.org/0000-0002-8507-5225>

## REFERENCES

1. Sammeth F. World Energy. Insights Brief 2019. Technical annex: global energy scenarios. Comparison review; 2019. <https://doi.org/10.13140/RG.2.2.32116.91526>.
2. Hammond GP, Akwe SO, Williams S. Techno-economic appraisal of fossil-fuelled power generation systems with carbon dioxide capture and storage. *Energy*. 2011;36(2): 975-984.
3. Outlook, B. E. 2019 edition. London, United Kingdom; 2019.
4. Adams T, Mac Dowell N. Off-design point modelling of a 420 MW CCGT power plant integrated with an amine-based post-combustion CO<sub>2</sub> capture and compression process. *Appl Energy*. 2016;178:681-702.
5. Wasiu AB, Aziz ARA, Heikal MR. The effect of carbon dioxide content-natural gas on the performance characteristics of engines: a review. *J Appl Sci*. 2012;12:2346-2350.
6. Copenhagen Economics. The future of fossil fuels: how to steer fossil fuel use in a transition to a low-carbon energy system. Energy Transitions Commission; 2017.

7. Hu Y, Xu G, Xu C, Yang Y. Thermodynamic analysis and techno-economic evaluation of an integrated natural gas combined cycle (NGCC) power plant with post-combustion CO<sub>2</sub> capture. *Appl Therm Eng.* 2017;111:308-316.
8. Cifre PG, Brechtel K, Hoch S, et al. Integration of a chemical process model in a power plant modelling tool for the simulation of an amine based CO<sub>2</sub> scrubber. *Fuel.* 2009;88(12): 2481-2488.
9. IEA. Energy technology perspectives 2012: pathways to a clean energy system; 2012.
10. IEA. (2017). *Energy Technology Perspectives 2017*, Author, Paris, France. <https://www.iea.org/reports/energy-technology-perspectives-2017>
11. Pérez-Fortes M, Moya JA, Vatopoulos K, Tzimas E. CO<sub>2</sub> capture and utilization in cement and iron and steel industries. *Energy Procedia.* 2014;63:6534-6543.
12. Meunier N, Laribi S, Dubois L, Thomas D, De Weireld G. CO<sub>2</sub> capture in cement production and re-use: first step for the optimization of the overall process. *Energy Procedia.* 2014;63: 6492-6503.
13. Duan HB, Fan Y, Zhu L. What's the most cost-effective policy of CO<sub>2</sub> targeted reduction: an application of aggregated economic technological model with CCS? *Appl Energy.* 2013;112: 866-875.
14. Vega F, Baena-Moreno FM, Fernández LMG, Portillo E, Navarrete B, Zhang Z. Current status of CO<sub>2</sub> chemical absorption research applied to CCS: towards full deployment at industrial scale. *Appl Energy.* 2020;260:114313.
15. Swennenhuis F, Mabon L, Flach TA, de Coninck H. What role for CCS in delivering just transitions? An evaluation in the North Sea region. *Int J Greenh Gas Con.* 2020;94:102903.
16. Mantripragada HC, Zhai H, Rubin ES. Boundary dam or petra nova—which is a better model for CCS energy supply? *Int J Greenh Gas Con.* 2019;82:59-68.
17. Budinis S, Krevor S, Mac Dowell N, Brandon N, Hawkes A. An assessment of CCS costs, barriers and potential. *Energ Strat Rev.* 2018;22:61-81.
18. Majoumerd MM, Breuhaus P, Smrekar J, et al. Impact of fuel flexibility needs on a selected GT performance in IGCC application. *ASME Turbo Expo 2012: Turbine Technical Conference and Exposition.* Copenhagen, Denmark: American Society of Mechanical Engineers; 2012:593-601.
19. Zucca A, Forte A, Giannini N, Romano C, Modi R. Enlarging fuel flexibility for Frame 5 DLN: combustor operability and emissions with high C<sup>2+</sup> content. *ASME Turbo Expo 2015: Turbine Technical Conference and Exposition.* Montreal, Quebec, Canada: American Society of Mechanical Engineers Digital Collection; 2015.
20. Viswanathan B. *Energy Sources: Fundamentals of Chemical Conversion Processes and Applications.* Oxford, United Kingdom: Newnes; 2016.
21. Faramawy S, Zaki T, Sakr AE. Natural gas origin, composition, and processing: a review. *J Nat Gas Sci Eng.* 2016;34:34-54.
22. Øi LE, Bråthen T, Berg C, et al. Optimization of configurations for amine based CO<sub>2</sub> absorption using Aspen HYSYS. *Energy Procedia.* 2014;51:224-233.
23. Abbott DJ, Bowers JP, James SR. The impact of natural gas composition variations on the operation of gas turbines for power generation. Paper presented at: Proceedings of the 6th International Conference on the Future of Gas Turbine Technology; 2012; Brussels, Belgium (pp. 17-18).
24. Liu K, Sanderson V. The influence of changes in fuel calorific value to combustion performance for Siemens SGT-300 dry low emission combustion system. *Fuel.* 2013;103:239-246.
25. Ali U, Agbonghae EO, Hughes KJ, Ingham DB, Ma L, Pourkashanian M. Techno-economic process design of a commercial-scale amine-based CO<sub>2</sub> capture system for natural gas combined cycle power plant with exhaust gas recirculation. *Appl Therm Eng.* 2016;103:747-758.
26. Agbonghae EO, Hughes KJ, Ingham DB, Ma L, Pourkashanian M. Optimal process design of commercial-scale amine-based CO<sub>2</sub> capture plants. *Ind Eng Chem Res.* 2014;53(38):14815-14829.
27. Diego ME, Bellas JM, Pourkashanian M. Process analysis of selective exhaust gas recirculation for CO<sub>2</sub> capture in natural gas combined cycle power plants using amines. *J Eng Gas Turb Power.* 2017;139(12):121701.
28. Diego ME, Bellas JM, Pourkashanian M. Techno-economic analysis of a hybrid CO<sub>2</sub> capture system for natural gas combined cycles with selective exhaust gas recirculation. *Appl Energy.* 2018;215:778-791.
29. Cormos CC. Assessment of chemical absorption/adsorption for post-combustion CO<sub>2</sub> capture from natural gas combined cycle (NGCC) power plants. *Appl Therm Eng.* 2015;82:120-128.
30. Li K, Cousins A, Yu H, et al. Systematic study of aqueous monoethanolamine-based CO<sub>2</sub> capture process: model development and process improvement. *Energy Sci Eng.* 2016;4(1):23-39.
31. Chu F, Yang L, Du X, Yang Y. CO<sub>2</sub> capture using MEA (monoethanolamine) aqueous solution in coal-fired power plants: modeling and optimization of the absorbing columns. *Energy.* 2016;109:495-505.
32. Berstad D, Arasto A, Jordal K, Haugen G. Parametric study and benchmarking of NGCC, coal and biomass power cycles integrated with MEA-based post-combustion CO<sub>2</sub> capture. *Energy Procedia.* 2011;4:1737-1744.
33. Nikpey H, Assadi M, Breuhaus P, Mørkved PT. Experimental evaluation and ANN modeling of a recuperative micro gas turbine burning mixtures of natural gas and biogas. *Appl Energy.* 2014;117:30-41.
34. Notz R, Mangalapally HP, Hasse H. Post combustion CO<sub>2</sub> capture by reactive absorption: pilot plant description and results of systematic studies with MEA. *Int J Greenh Gas Con.* 2012;6: 84-112.
35. von Harbou I, Imle M, Hasse H. Modeling and simulation of reactive absorption of CO<sub>2</sub> with MEA: results for four different packings on two different scales. *Chem Eng Sci.* 2014;105: 179-190.
36. Boot-Handford ME, Abanades JC, Anthony EJ, et al. Carbon capture and storage update. *Energ Environ Sci.* 2014;7(1): 130-189.
37. DOE/NETL. Current and future technologies for natural gas combined cycle (NGCC) power plants. Report No. DOE/NETL-341/061013; 2013. <https://www.netl.doe.gov/energy-analysis/details?id=607>
38. Lawal A, Wang M, Stephenson P, Obi O. Demonstrating full-scale post-combustion CO<sub>2</sub> capture for coal-fired power plants through dynamic modelling and simulation. *Fuel.* 2012;101: 115-128.

39. Vaccarelli M, Sammak M, Jonshagen K, Carapellucci R, Genrup M. Combined cycle power plants with post-combustion CO<sub>2</sub> capture: energy analysis at part load conditions for different HRSG configurations. *Energy*. 2016;112:917-925.
40. Zornek T, Monz T, Aigner M. Performance analysis of the micro gas turbine Turbec T100 with a new FLOX-combustion system for low calorific fuels. *Appl Energy*. 2015;159:276-284.
41. PSE Products - Power & CCS - gCCS product overview. <https://www.psenderprise.com/products/gccs>. Accessed April 7, 2020.
42. Del Rio MS, Gibbins J, Lucquiaud M. On the retrofitting and repowering of coal power plants with post-combustion carbon capture: an advanced integration option with a gas turbine windbox. *Int J Greenh Gas Con*. 2017;58:299-311.
43. Dettori S, Colla V, Salerno G, Signorini A. Steam turbine models for monitoring purposes. *Energy Procedia*. 2017;105:524-529.
44. Rezazadeh F, Gale WF, Akram M, Hughes KJ, Pourkashanian M. Performance evaluation and optimisation of post combustion CO<sub>2</sub> capture processes for natural gas applications at pilot scale via a verified rate-based model. *Int J Greenh Gas Con*. 2016;53:243-253.
45. Luo X, Wang M, Chen J. Heat integration of natural gas combined cycle power plant integrated with post-combustion CO<sub>2</sub> capture and compression. *Fuel*. 2015;151:110-117.
46. Perry RH, Green DW. *Perry's Chemical Engineers' Handbook*. 8th Illustrated ed. New York, NY: McGraw-Hill; 2007.
47. Kister H. *Distillation Design*. New York, NY: McGraw-Hill; 2013.
48. Billet R, Schultes M. Prediction of mass transfer columns with dumped and arranged packings: updated summary of the calculation method of Billet and Schultes. *Chem Eng Res Design*. 1999;77(6):498-504.
49. Canepa R, Wang M. Techno-economic analysis of a CO<sub>2</sub> capture plant integrated with a commercial scale combined cycle gas turbine (CCGT) power plant. *Appl Therm Eng*. 2015;74:10-19.
50. Akram M, Ali U, Best T, Blakey S, Finney KN, Pourkashanian M. Performance evaluation of PACT pilot-plant for CO<sub>2</sub> capture from gas turbines with exhaust gas recycle. *Int J Greenh Gas Con*. 2016;47:137-150.
51. Iliuta I, Larachi F, Fourati M, Raynal L, Roig V. Flooding limit in countercurrent gas-liquid structured packed beds—prediction from a linear stability analysis of an Eulerian two-fluid model. *Chem Eng Sci*. 2014;120:49-58.
52. Turner MJ, Pinkerton LL. Quality guidelines for energy system studies: capital cost scaling methodology. In Final Report DOE/NETL-341/013113; 2013.
53. Gerdes K, Summers WM, Wimer J. Cost estimation methodology for NETL assessments of power plant performance. US Department of Energy, National Energy Technology Laboratories, Report No. DOE/NETL-2011/1455; 2011.

## SUPPORTING INFORMATION

Additional supporting information may be found online in the Supporting Information section at the end of this article.

**How to cite this article:** Omehia KC, Clements AG, Michailos S, Hughes KJ, Ingham DB, Pourkashanian M. Techno-economic assessment on the fuel flexibility of a commercial scale combined cycle gas turbine integrated with a CO<sub>2</sub> capture plant. *Int J Energy Res*. 2020;1-14. <https://doi.org/10.1002/er.5681>