

This is a repository copy of *Thermal impact on the performance ratio of photovoltaic systems : a case study of 8000 photovoltaic installations.*

White Rose Research Online URL for this paper:

<https://eprints.whiterose.ac.uk/177724/>

Version: Accepted Version

Article:

Dhimish, Mahmoud (2020) Thermal impact on the performance ratio of photovoltaic systems : a case study of 8000 photovoltaic installations. *Case Studies in Thermal Engineering*. 100693. ISSN 2214-157X

<https://doi.org/10.1016/j.csite.2020.100693>

Reuse

This article is distributed under the terms of the Creative Commons Attribution-NonCommercial-NoDerivs (CC BY-NC-ND) licence. This licence only allows you to download this work and share it with others as long as you credit the authors, but you can't change the article in any way or use it commercially. More information and the full terms of the licence here: <https://creativecommons.org/licenses/>

Takedown

If you consider content in White Rose Research Online to be in breach of UK law, please notify us by emailing eprints@whiterose.ac.uk including the URL of the record and the reason for the withdrawal request.

Thermal Impact on the Performance Ratio of Photovoltaic Systems: a case study of 8000 photovoltaic installations

Mahmoud Dhimish

University of Huddersfield, Department of Engineering and Technology, Huddersfield HD1 3DH, UK

Abstract:

Investigating the thermal impact including the fluctuations of the solar irradiance and ambient temperature of photovoltaic (PV) systems is a topic of great interest by industry and policymakers, due to the limited case studies reported so far by the PV research community. Therefore, this article presents the analysis of 8000 PV systems distributed across England using the well-known metric, monthly performance ratio (PR). The PV systems were operated over five years, while the PR is calculated using the newly developed model by the US national renewable energy laboratory (NREL). Remarkably, it was found that the average monthly PR for all examined PV systems is equal to 85.74%, where the Midlands region in the UK has the highest monthly PR of 88.12 %. We have also investigated the seasonal thermal impact on the performance of PV systems, where it was concluded that Spring and Summer seasons intend to have higher monthly PR compared to Autumn and Winter. Finally, a detailed experiment of three different PV modules affected by various hotspots, including cell-based and string-based, will be comprehensively discussed.

Keywords: Photovoltaic systems; Performance Ratio; Thermal Imaging; Hotspots.

1. Introduction

By the end of 2019, the UK solar photovoltaic (PV) installations capacity reached 15 GW. Several studies have deliberated the performance of PV systems [1]. However, there are few publications which study the performance of PV installations across the UK, particularly relating to the thermal impact including the variations of the solar irradiance and ambient temperature among multiple regions across the country.

Studying the performance of PV installations are predominantly calculated and exhibited using the analysis of the monthly or even daily performance ratio (PR). The PR is a popular metric used to indicate the total generation of the output power of PV installations [2]; wherein theory, 100% shows no losses associated with the PV installation. In existing PV installations, as a worldwide point of view, the PR is usually ranging from as low as 10-20% up to 95%.

Several environmental conditions influence the PR ratio, including, but not limited to, the thermal variations including the amount of solar irradiance received by the PV modules and the fluctuations in the ambient temperature [3]. Another good example of the environmental conditions is the wind speed and the humidity, as PV systems perform better when the wind speed is at greater levels or less humidity in the PV location [4].

Besides, some research correlates the performance of PV installations with the season of the year [5]. This is a fair comparison, as in the winter seasons, shading is likely to occur due to the moving clouds, resulting in a

significant drop in the PR ratio. In contrast, summer seasons show higher PR ratios as the clear sky, and overcasting conditions are likely to happen.

According to other research findings [6], the PR ratios of PV systems are likely to drop in winter seasons because of the presence of hotspotting phenomenon. Hotspotting occurs when one or multiple solar cells operates in the breakdown, hence, resulting in a significant drop in the output current while also maintaining a substantial increase in the temperature of the affected cells. The main reason of the presence of hotspots in PV modules is due to the thermal fluctuations of the solar and ambient temperature affecting the PV modules [7], in addition, hotspots are likely to occur to the increasing amount of shading on solar cells. Nowadays, thermal imaging cameras are habitually used to detect hotspots in PV modules, where it can be easily identified [8, 9].

The main contributions of this article are, (i) examining the monthly PR of 8000 PV installations distributed across England, (ii) analysing the seasonal impact on the PR for the PV installations located in the Midlands, and finally, (iii) investigating the effect of hotspotting phenomenon on the PR of different PV modules.

2. Examined PV installations

In this study, we have examined 8000 crystalline silicon (c-Si) made PV installations distributed across England, operating for five years; 2015 to 2019. Fig. 1(a) shows the three regions of England, including northern England, the Midlands, and southern England. In Fig. 1(b) we show the number of inspected PV installations in each region. All PV installations are for residential use with a capacity ranging from 1.2 to 3.8 kWh. The PV generation data is collected via the MgDB database [10], where only the monthly dataset is considered in our investigation of the PV performance analysis.

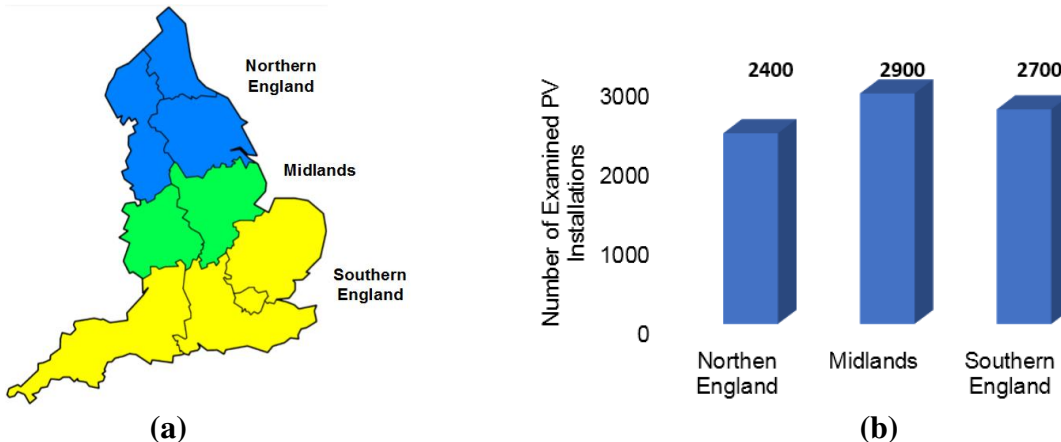


Fig. 1. (a) Northern England is shown in blue, the Midlands as green, and southern England as yellow, (b) Number of examined PV installations distributed across each location.

3. Monthly PR analysis

The calculation of the monthly performance for all examined PV systems has been done using the well-established PR calculation model of the US national renewable energy laboratory (NREL) [11]. The PR at standard test conditions (STC) is calculated, where the solar irradiance is equal to 1000 W/m^2 . The ambient temperature of $25 \text{ }^\circ\text{C}$, PR is the uncorrected performance ratio, f_T is the corrected temperature of a given PV system, f_G is the corrected solar irradiance; the following equation gives the monthly PR at STC:

$$\text{Monthly PR at STC} = \frac{PR}{f_T \times f_G} \quad (1)$$

The f_T and f_G are given the following equations, where S is equivalent to the temperature coefficient of the PV installation (taken from the datasheet of the PV modules and has a negative value), T_{STC} is equal to 25 C, while the irradiance-weighted mean cell temperature is given by $T_{weighted}$. According to the f_G calculation, c is the reducing in the PV system efficiency due to the decrease of the solar irradiance, the typical value of c is 0.031 for c-Si PV modules, $G_{weighted}$ is the weighted irradiance in the plane of the PV array for the commencing month, and last, G_{STC} is equal to 1000 W/m².

$$f_T = \left[1 - \frac{S}{100} (T_{STC} - T_{weighted}) \right] \tag{2}$$

$$f_G = \left[1 + c \ln \left(\frac{G_{weighted}}{G_{STC}} \right) \right] \tag{3}$$

The average monthly estimated $T_{weighted}$ and $G_{weighted}$ for all 8000 examined PV installations are shown in **Fig. 2**; five years has been taken into account as these PV installations are operating over the last five years. Correspondingly, these parameters of the weighted temperature and irradiance are highly affected by the season of the year. As a result, there is a substantial seasonal and inter-annual disparities in the analysis of the PR which will be discussed in the following sections.

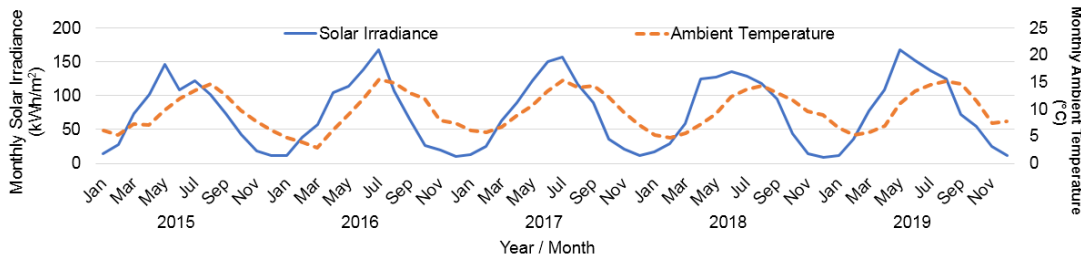


Fig. 2. Monthly solar irradiance and ambient temperature in England from 2015 to 2019.

4. Results and discussions

The distribution of the monthly-integrated PR is presented in **Fig. 3**. The shape of the distribution is characterised using the Weibull function [12], the rationale of using this type of distribution since it is well-suited with datasets that have an insignificant skew in the lower range. And as presented in **Fig. 3**, the data shape is concentrated in the ranges of 60-95%. According to the monthly PR calculated throughout 5-years, it was found that the Midlands has the largest “scale” monthly PR of 88.12%. Southern and northern England have a monthly PR of 85.12% and 83.98%, respectively.

According to the historical thermal environmental events “variations of the solar irradiance and ambient temperature”, the Midlands has the lowest fluctuations during the seasons of the year [13], hence, thermally

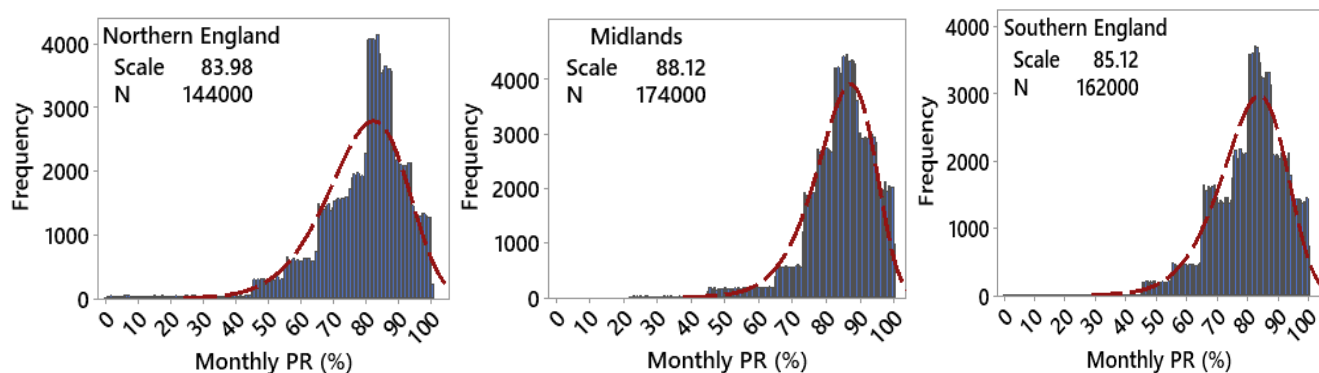


Fig. 3. Monthly calculated PR for northern England, the Midlands, and Southern England.

speaking, there is less thermal impact on the performance of the PV installations; therefore, the Midlands as expected have the highest possible monthly PR ratio. In contrast, Northern England have the highest rates of thermal instabilities. Therefore, PV installations located in Northern England have the lowest monthly PR of 83.98%.

As the Midlands have the highest monthly PR, we have calculated the seasonal impact on the performance of the PV installations located in this region; results are presented in Fig. 4. It is noticeable that during the spring seasons (March-May) the PV installation intends to have the highest possible monthly PR of 91.62%, however, as expected, the lowest monthly PR of 84.04% is found during the Winter season (December-February) as during these months the PV installations are predominantly affected by shading conditions [14], and as a result, the existence of hotspots become the main reason of the decay in the performance ratio.

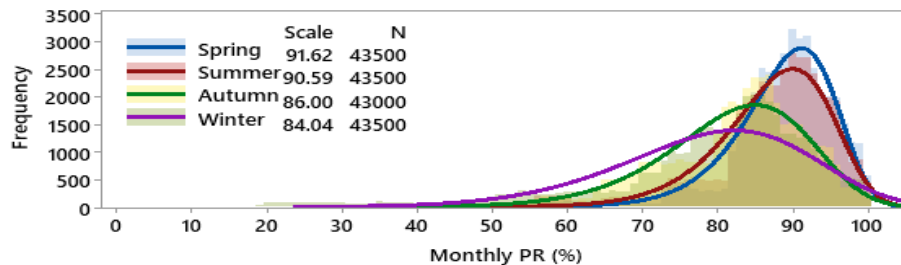


Fig. 4. Seasonal calculated PR for the Midlands.

To examine the impact of hotspots on the performance ratio of PV modules, we have experimented for a period of 12-months, three adjacent PV modules affected by different types of hotspots. The thermography images of the examined PV modules and their daily PR analysis is presented in Fig. 5. The first PV module (no. 1) is affected by two hotspotted solar cells, second PV module (no. 2) is affected by multiple hotspots, while the last PV module (no. 3) is affected by hotspotted PV string.

During the 12-months experiment, the daily PR ratio is equal to 90.64% for the first PV module. Increasing the number of hotspots in the PV module, as in PV module no.2 would result in a decrease in the total power generation; as a result, the daily PR drops at a low level of 79.20%. The lowest daily PR of 65.35% is determined for the last PV module because this module is suffering from a high rate of power loss due to the presence of the hotspotted PV string.

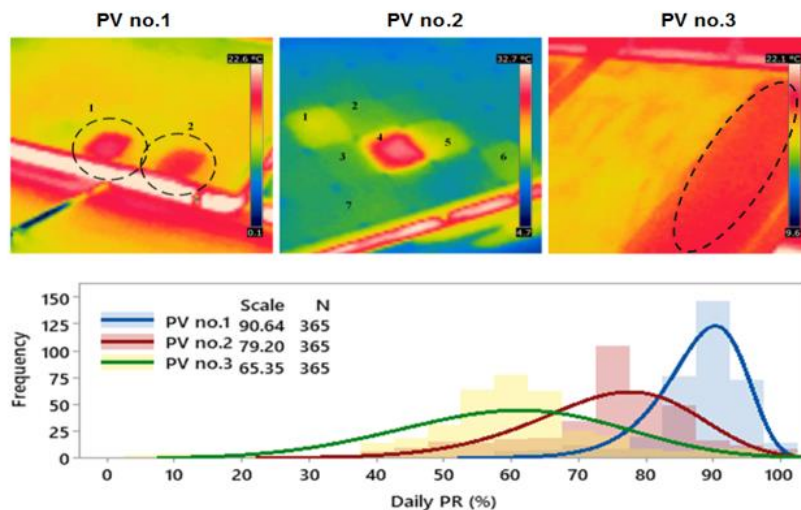


Fig. 5. Calculated PR for three different PV modules affected by different hotspotting conditions.

5. Conclusions

To conclude, in this case study, we have analysed the PR of 8000 PV modules distributed across three regions in England using the well-known PR method of NREL. It was observed that the Midlands have the highest monthly PR, while the lowest is found for Northern England. In addition, the seasonal impact on the PR analysis was determined using the same method for all PV installations located in the Midlands, where it was observed that Spring and Summer seasons intend to have higher monthly PR compared to Autumn and Winter. Furthermore, a case study on three different PV modules affected by various hotspotting conditions have been reported. Increasing hotspots in PV modules would result in a greater drop in the daily PR. There is a significant drop in the daily PR for PV modules affected by hotspotted PV strings.

Acknowledgements:

This research was supported by the POC funding grant from the Department of Engineering and Technology, University of Huddersfield, United Kingdom.

References:

- [1]. M. Hussain, M. Dhimish, S. Titarenko, P. Mather, Artificial neural network based photovoltaic fault detection algorithm integrating two bi-directional input parameters, *Renewable Energy*. (2020) 155.
- [2]. D. Cocco, A. Costa, Effect of a global warming model on the energetic performance of a typical solar photovoltaic system, *Case Studies in Thermal Engineering*. (2019) 14.
- [3]. A. Al-Waeli, M. Chaichan, K. Sopian, H. Kazem, Influence of the base fluid on the thermo-physical properties of PV/T nanofluids with surfactant, *Case Studies in Thermal Engineering*. (2019) 13.
- [4]. A. Soliman, H. Hassan, M. Ahmed, S. Ookawara, A 3d model of the effect of using heat spreader on the performance of photovoltaic panel (PV), *Mathematics and Computers in Simulation*. (2020) 167.
- [5]. M. Shravanth Vasisht, J. Srinivasan, S. Ramasesha, Performance of solar photovoltaic installations: Effect of seasonal variations, *Solar Energy*. (2016) 131.
- [6]. M. Dhimish, P. Mather, V. Holmes, Evaluating power loss and performance ratio of hot-spotted photovoltaic modules, *IEEE Transactions on Electron Devices*. (2018) 65.
- [7]. F. Bayrak, F. Oztop, Effects of static and dynamic shading on thermodynamic and electrical performance for photovoltaic panels, *Applied Thermal Engineering*. (2020) 169.
- [8]. M. Dhimish, Current limiter circuit to avoid photovoltaic mismatch conditions including hot-spots and shading, *Renewable Energy*. (2020) 145.
- [9]. J. Gosumbonggot, G. Fujita, Global maximum power point tracking under shading condition and hotspot detection algorithms for photovoltaic systems, *Energies*. (2019) 12.
- [10]. Sheffield solar, Microgen Database, University of Sheffield. (2020). <http://www.microgen-database.org.uk/>.
- [11]. D. Jordan, C. Deline, R. Kurtz, M. Kimball, M. Anderson, Robust PV degradation methodology and application, *IEEE Journal of photovoltaics*. (2017) 8.
- [12]. M. Dhimish, P. Mather, V. Holmes, Novel photovoltaic hot-spotting fault detection algorithm, *IEEE Transactions on Device and Materials Reliability*. (2019) 19.
- [13]. M. Dhimish, V. Holmes, P. Mather, M. Sibley, Preliminary assessment of the solar resource in the United Kingdom, *Clean Energy*. (2018) 2.
- [14]. M. Dhimish, A. Alrashidi, Photovoltaic Degradation Rate Affected by Different Weather Conditions: A Case Study Based on PV Systems in the UK and Australia, *Electronics*. (2020) 9.